

**OUTFALL 001 (South Slope below Perimeter Pond)**

**ANNUAL 2009 REPORTING SUMMARY  
THE BOEING COMPANY  
SANTA SUSANA FIELD LABORATORY  
NPDES PERMIT CA0001309**

January 1 through December 31, 2009

ANALYTE	UNITS	Benchmark Limit Daily Max/Monthly Avg	2/16/2009	
			RESULT	VALIDATION QUALIFIER
Ammonia as Nitrogen (N)	mg/L	10.1/1.96	0.56	*
Biochemical Oxygen Demand (BOD 5 day)	mg/L	30/20	2.4	*
Chloride	mg/L	150/-	10	*
Specific Conductivity (Lab)	umhos/cm	-/-	120	--
Surfactants (MBAS)	mg/L	0.5/-	0.097	J* (DNQ)
Fluoride	mg/L	1.6/-	0.12	B*
Nitrate + Nitrite as Nitrogen (N)	mg/L	8.0/-	1.4	*
Nitrate as Nitrogen (N)	mg/L	8.0/-	1.4	*
Nitrite-N	mg/L	1.0/-	ND < 0.090	*
Oil & Grease	mg/L	15/10	1.9	J* (DNQ)
Perchlorate	ug/L	6.0/-	ND < 0.90	*
pH (Field)	pH units	6.5-8.5/-	7.1	*
Total Settleable Solids	ml/L	0.3/0.1	0.20	pH*
Sulfate	mg/L	300/-	9.7	*
Temperature	deg. F	86/-	48	*
Total Cyanide	ug/L	8.5/4.3	ND < 2.2	*
Total Dissolved Solids	mg/L	950/-	120	*
Hardness	mg/L	-/-	46	--
Hardness, dissolved	mg/L	-/-	37	--
Total Organic Carbon	mg/L	-/-	10	--
Total Residual Chlorine	mg/L	0.1/-	ND < 0.10	HFT*
Total Suspended Solids	mg/L	45/15	92	--
Turbidity	NTU	-/-	140	--
Volume Discharged	MGD	160/-	0.197025	*
<b>METALS</b>				
Antimony	ug/L	6.0/-	ND < 2.0	U (B)
Antimony, dissolved	ug/L	-/-	ND < 2.0	U (B)
Arsenic	ug/L	10/-	ND < 7.0	U
Arsenic, dissolved	ug/L	-/-	ND < 7.0	U
Barium	mg/L	1.0/-	0.073	--
Barium, dissolved	mg/L	-/-	0.013	--
Beryllium	ug/L	4.0/-	ND < 0.90	U
Beryllium, dissolved	ug/L	-/-	ND < 0.90	U
Boron	mg/L	-/-	0.043	J (DNQ)
Boron, dissolved	mg/L	-/-	ND < 0.050	U (B)
Cadmium	ug/L	3.1/2.0	0.14	J (DNQ)
Cadmium, dissolved	ug/L	-/-	0.14	J (DNQ)
Calcium	mg/L	-/-	11	--
Calcium, Dissolved	mg/L	-/-	9.8	--
Chromium	ug/L	16.3/8.1	ND < 10	U (B)
Chromium, dissolved	ug/L	-/-	ND < 2.0	U
Chromium VI	ug/L	16.3/8.1	ND < 0.25	*
Cobalt	ug/L	-/-	2.5	J (DNQ)
Cobalt, dissolved	ug/L	-/-	ND < 2.0	U
Copper	ug/L	14.0/7.1	6.6	J (*III)
Copper, dissolved	ug/L	-/-	2.3	--
Iron	mg/L	0.3/-	8.1	--
Iron, dissolved	mg/L	-/-	0.45	--

**OUTFALL 001 (South Slope below Perimeter Pond)**

**ANNUAL 2009 REPORTING SUMMARY  
THE BOEING COMPANY  
SANTA SUSANA FIELD LABORATORY  
NPDES PERMIT CA0001309**

January 1 through December 31, 2009

ANALYTE	UNITS	Benchmark Limit Daily Max/Monthly Avg	2/16/2009	
			RESULT	VALIDATION QUALIFIER
Lead	ug/L	5.2/2.6	6.6	--
Lead, dissolved	ug/L	-/-	0.31	J (DNQ)
Magnesium	mg/L	-/-	4.6	--
Magnesium, Dissolved	mg/L	-/-	3.0	--
Manganese	ug/L	50/-	110	--
Manganese, dissolved	ug/L	-/-	12	J (DNQ)
Mercury	ug/L	0.10/0.05	ND < 0.027	U
Mercury, dissolved	ug/L	-/-	ND < 0.027	U
Nickel	ug/L	96/35	ND < 10	U (B)
Nickel, dissolved	ug/L	-/-	ND < 2.0	U
Selenium	ug/L	8.2/4.1	0.52	J (*III, DNQ)
Selenium, dissolved	ug/L	-/-	ND < 2.0	U (B)
Silver	ug/L	4.1/2.0	ND < 0.30	U
Silver, dissolved	ug/L	-/-	ND < 0.30	U
Thallium	ug/L	2.0/-	ND < 0.20	U
Thallium, dissolved	ug/L	-/-	ND < 0.20	U
Vanadium	ug/L	-/-	19	--
Vanadium, dissolved	ug/L	-/-	ND < 3.0	U
Zinc	ug/L	119/54	37	--
Zinc, dissolved	ug/L	-/-	15	J (*III, B, DNQ)
<b>ORGANICS</b>				
Benzene	ug/L	-/-	ND < 0.28	*
Carbon Tetrachloride	ug/L	-/-	ND < 0.28	*
Chloroform	ug/L	-/-	ND < 0.33	*
1,1-Dichloroethane	ug/L	-/-	ND < 0.40	*
1,2-Dichloroethane	ug/L	-/-	ND < 0.28	*
1,1-Dichloroethene	ug/L	6.0/3.2	ND < 0.42	*
1,4-Dioxane	ug/L	-/-	ND < 1.0	*
Ethylbenzene	ug/L	-/-	ND < 0.25	*
Tetrachloroethene	ug/L	-/-	ND < 0.32	*
Toluene	ug/L	-/-	ND < 0.36	*
Xylenes (Total)	ug/L	-/-	ND < 0.90	*
1,1,1-Trichloroethane	ug/L	-/-	ND < 0.30	*
1,1,2-Trichloroethane	ug/L	-/-	ND < 0.30	*
Trichloroethene	ug/L	5.0/-	ND < 0.26	*
Trichlorofluoromethane	ug/L	-/-	ND < 0.34	*
Trichlorotrifluoroethane (Freon 113)	ug/L	-/-	ND < 0.50	*
Vinyl Chloride	ug/L	-/-	ND < 0.40	*
<b>TPH</b>				
DRO (C13 - C28)	mg/L	-/-	ND < 0.047	*
GRO (C4 - C12)	mg/L	-/-	ND < 0.025	*
<b>ADDITIONAL ANALYTES</b>				
1,2-Dichloro-1,1,2-trifluoroethane	ug/L	-/-	ND < 2.5	*
2,4,5-Trichlorophenol	ug/L	-/-	ND < 0.19	U
1,1,2,2-Tetrachloroethane	ug/L	-/-	ND < 0.30	*
1,2,4-Trichlorobenzene	ug/L	-/-	ND < 0.094	U
1,2-Dichlorobenzene (EPA 624)	ug/L	-/-	ND < 0.32	*
1,2-Dichlorobenzene (EPA 625)	ug/L	-/-	ND < 0.094	U
1,2-Dichloropropane	ug/L	-/-	ND < 0.35	*

**OUTFALL 001 (South Slope below Perimeter Pond)**

**ANNUAL 2009 REPORTING SUMMARY  
THE BOEING COMPANY  
SANTA SUSANA FIELD LABORATORY  
NPDES PERMIT CA0001309**

January 1 through December 31, 2009

ANALYTE	UNITS	Benchmark Limit Daily Max/Monthly Avg	2/16/2009	
			RESULT	VALIDATION QUALIFIER
1,2-Diphenylhydrazine/Azobenzene	ug/L	-/-	ND < 0.094	U
1,3-Dichlorobenzene (EPA 625)	ug/L	-/-	ND < 0.094	U
1,3-Dichlorobenzene (EPA 624)	ug/L	-/-	ND < 0.35	*
1,4-Dichlorobenzene (EPA 625)	ug/L	-/-	ND < 0.19	U
1,4-Dichlorobenzene (EPA 624)	ug/L	-/-	ND < 0.37	*
2,4,6-Trichlorophenol	ug/L	13.0/6.5	ND < 0.094	U
2,4-Dichlorophenol	ug/L	-/-	ND < 0.19	U
2,4-Dimethylphenol	ug/L	-/-	ND < 0.28	U
2,4-Dinitrophenol	ug/L	-/-	ND < 0.85	U
2,4-Dinitrotoluene	ug/L	18.3/9.1	ND < 0.19	U
2,6-Dinitrotoluene	ug/L	-/-	ND < 0.094	UJ (*III)
2-Chloroethylvinylether	ug/L	-/-	ND < 1.8	*
2-Chloronaphthalene	ug/L	-/-	ND < 0.094	U
2-Chlorophenol	ug/L	-/-	ND < 0.19	U
2-Methyl-4,6-dinitrophenol	ug/L	-/-	ND < 0.19	U
2-Methylnaphthalene	ug/L	-/-	ND < 0.094	U
2-Methylphenol	ug/L	-/-	ND < 0.094	UJ (*III)
2-Nitrophenol	ug/L	-/-	ND < 0.094	U
3,3'-Dichlorobenzidine	ug/L	-/-	ND < 4.7	U
4,4'-DDD	ug/L	-/-	ND < 0.0019	UJ (C)
4,4'-DDE	ug/L	-/-	ND < 0.0028	UJ (C)
4,4'-DDT	ug/L	-/-	ND < 0.0038	UJ (C)
4-Bromophenylphenylether	ug/L	-/-	ND < 0.094	U
4-Chloro-3-methylphenol	ug/L	-/-	ND < 0.19	U
4-Chloroaniline	ug/L	-/-	ND < 0.094	UJ (*III)
4-Chlorophenylphenylether	ug/L	-/-	ND < 0.094	U
4-Nitrophenol	ug/L	-/-	ND < 2.4	U
Acenaphthene	ug/L	-/-	ND < 0.094	U
Acenaphthylene	ug/L	-/-	ND < 0.094	U
Acrolein	ug/L	-/-	ND < 4.0	C*
Acrylonitrile	ug/L	-/-	ND < 0.70	C*
Acute Toxicity	% SURVIVAL	70-100/-	100	*
Aldrin	ug/L	-/-	ND < 0.0014	UJ (C)
alpha-BHC	ug/L	0.03/0.01	ND < 0.0053	UJ (H)
Aniline	ug/L	-/-	ND < 0.28	U
Anthracene	ug/L	-/-	ND < 0.094	U
Aroclor-1016	ug/L	-/-	ND < 0.24	*
Aroclor-1221	ug/L	-/-	ND < 0.24	*
Aroclor-1232	ug/L	-/-	ND < 0.24	*
Aroclor-1242	ug/L	-/-	ND < 0.24	*
Aroclor-1248	ug/L	-/-	ND < 0.24	*
Aroclor-1254	ug/L	-/-	ND < 0.24	*
Aroclor-1260	ug/L	-/-	ND < 0.24	*
Benzidine	ug/L	-/-	ND < 4.7	U
Benzo(a)anthracene	ug/L	-/-	ND < 0.094	U
Benzo(a)pyrene	ug/L	-/-	ND < 0.094	U
Benzo(b)fluoranthene	ug/L	-/-	ND < 0.094	U
Benzo(g,h,i)perylene	ug/L	-/-	ND < 0.094	U
Benzo(k)fluoranthene	ug/L	-/-	ND < 0.094	U

**OUTFALL 001 (South Slope below Perimeter Pond)**

**ANNUAL 2009 REPORTING SUMMARY  
THE BOEING COMPANY  
SANTA SUSANA FIELD LABORATORY  
NPDES PERMIT CA0001309**

January 1 through December 31, 2009

ANALYTE	UNITS	Benchmark Limit Daily Max/Monthly Avg	2/16/2009	
			RESULT	VALIDATION QUALIFIER
Benzoic acid	ug/L	-/-	ND < 2.8	U
Benzyl alcohol	ug/L	-/-	ND < 0.094	UJ (*III)
beta-BHC	ug/L	-/-	ND < 0.0038	U
bis (2-Chloroethyl) ether	ug/L	-/-	ND < 0.094	U
bis (2-ethylhexyl) Phthalate	ug/L	4.0/-	ND < 1.6	U
bis(2-Chloroethoxy) methane	ug/L	-/-	ND < 0.094	UJ (*III)
bis(2-Chloroisopropyl) ether	ug/L	-/-	ND < 0.094	U
Bromodichloromethane	ug/L	-/-	ND < 0.30	*
Bromoform	ug/L	-/-	ND < 0.40	*
Bromomethane	ug/L	-/-	ND < 0.42	*
Butylbenzylphthalate	ug/L	-/-	ND < 4.7	U (B)
Chlordane	ug/L	-/-	ND < 0.038	U
Chlorobenzene	ug/L	-/-	ND < 0.36	*
Chloroethane	ug/L	-/-	ND < 0.40	*
Chloromethane	ug/L	-/-	ND < 0.40	*
Chronic Toxicity	TUC	1.0/-	1.0	*
Chrysene	ug/L	-/-	ND < 0.094	U
cis-1,2-Dichloroethene	ug/L	-/-	ND < 0.32	*
cis-1,3-Dichloropropene	ug/L	-/-	ND < 0.22	L*
Cyclohexane	ug/L	-/-	ND < 2.5	*
delta-BHC	ug/L	-/-	ND < 0.0033	UJ (C)
Dibenzo(a,h)anthracene	ug/L	-/-	ND < 0.094	U
Dibenzofuran	ug/L	-/-	ND < 0.094	U
Dibromochloromethane	ug/L	-/-	ND < 0.40	*
Dieldrin	ug/L	-/-	ND < 0.0019	UJ (C)
Diethylphthalate	ug/L	-/-	0.11	J (DNQ)
Dimethylphthalate	ug/L	-/-	ND < 0.094	U
Di-n-butylphthalate	ug/L	-/-	ND < 0.19	U
Di-n-octylphthalate	ug/L	-/-	ND < 0.094	U
Endosulfan I	ug/L	-/-	ND < 0.0019	UJ (C)
Endosulfan II	ug/L	-/-	ND < 0.0028	UJ (C)
Endosulfan sulfate	ug/L	-/-	ND < 0.0028	UJ (C)
Endrin	ug/L	-/-	ND < 0.0019	UJ (C)
Endrin aldehyde	ug/L	-/-	ND < 0.0019	UJ (C)
Endrin ketone	ug/L	-/-	ND < 0.0028	UJ (C)
Fluoranthene	ug/L	-/-	ND < 0.094	U
Fluorene	ug/L	-/-	ND < 0.094	U
Heptachlor	ug/L	-/-	ND < 0.0028	UJ (C)
Heptachlor epoxide	ug/L	-/-	ND < 0.0024	UJ (C)
Hexachlorobenzene	ug/L	-/-	ND < 0.094	U
Hexachlorobutadiene	ug/L	-/-	ND < 0.19	U
Hexachlorocyclopentadiene	ug/L	-/-	ND < 0.094	U
Hexachloroethane	ug/L	-/-	ND < 0.19	U
Hydrazine	ug/L	-/-	ND < 0.60	UJ (C)
Unsymmetrical Dimethyl Hydrazine	ug/L	-/-	ND < 1.42	U
Indeno(1,2,3-cd)pyrene	ug/L	-/-	ND < 0.094	U
Isophorone	ug/L	-/-	ND < 0.094	UJ (*III)
Lindane (gamma-BHC)	ug/L	-/-	ND < 0.0028	UJ (C)
Methoxychlor	ug/L	-/-	ND < 0.0033	UJ (C)

**OUTFALL 001 (South Slope below Perimeter Pond)**

**ANNUAL 2009 REPORTING SUMMARY  
THE BOEING COMPANY  
SANTA SUSANA FIELD LABORATORY  
NPDES PERMIT CA0001309**

January 1 through December 31, 2009

ANALYTE	UNITS	Benchmark Limit Daily Max/Monthly Avg	2/16/2009	
			RESULT	VALIDATION QUALIFIER
Methylene Chloride	ug/L	-/-	ND < 0.95	*
m-Nitroaniline	ug/L	-/-	ND < 0.19	U
Monomethyl Hydrazine	ug/L	-/-	ND < 1.70	U
Naphthalene	ug/L	-/-	ND < 0.094	U
Nitrobenzene	ug/L	-/-	ND < 0.094	U
n-Nitrosodimethylamine	ug/L	16.3/8.1	ND < 0.094	U
n-Nitroso-di-n-propylamine	ug/L	-/-	ND < 0.094	UJ (*III)
n-Nitrosodiphenylamine	ug/L	-/-	ND < 0.094	U
o-Nitroaniline	ug/L	-/-	ND < 0.094	U
p-Cresol	ug/L	-/-	ND < 0.19	U
Pentachlorophenol	ug/L	16.5/8.2	1.5	J (DNQ)
Phenanthrene	ug/L	-/-	ND < 0.094	U
Phenol	ug/L	-/-	ND < 0.28	U
p-Nitroaniline	ug/L	-/-	ND < 0.47	UJ (*III)
Pyrene	ug/L	-/-	ND < 0.094	U
Toxaphene	ug/L	-/-	ND < 0.24	U
trans-1,2-Dichloroethene	ug/L	-/-	ND < 0.30	*
trans-1,3-Dichloropropene	ug/L	-/-	ND < 0.32	*

**OUTFALL 001 (South Slope below Perimeter Pond)**

**ANNUAL 2009 REPORTING SUMMARY  
THE BOEING COMPANY  
SANTA SUSANA FIELD LABORATORY  
NPDES PERMIT CA0001309**

January 1 through December 31, 2009

<b>ANALYTE</b>	<b>UNITS</b>	<b>Benchmark Limit Monthly Ava</b>	<b>February Average Concentration</b>
Ammonia as Nitrogen (N)	mg/L	1.96	0.56
Biochemical Oxygen Demand (BOD 5 day)	mg/L	20	2.4
Oil & Grease	mg/L	10	1.9
Total Settleable Solids	ml/L	0.1	0.20
Total Cyanide	ug/L	4.3	ND < 2.2
Total Suspended Solids	mg/L	15	92
Cadmium	ug/L	2	0.14
Chromium VI	ug/L	8.1	ND < 0.25
Copper	ug/L	7.1	6.6
Lead	ug/L	2.6	6.6
Mercury	ug/L	0.05	ND < 0.027
Nickel	ug/L	35	ND < 10
Selenium	ug/L	4.1	0.52
Silver	ug/L	2	ND < 0.30
Zinc	ug/L	54	37
1,1-Dichloroethene	ug/L	3.2	ND < 0.42
2,4,6-Trichlorophenol	ug/L	6.5	ND < 0.094
2,4-Dinitrotoluene	ug/L	9.1	ND < 0.19
alpha-BHC	ug/L	0.01	ND < 0.0053
n-Nitrosodimethylamine	ug/L	8.1	ND < 0.094
Pentachlorophenol	ug/L	8.2	1.5
TCDD TEQ w/out DNQ Values	ug/L	1.40E-08	7.31E-07

**OUTFALL 001 (South Slope below Perimeter Pond)**

**ANNUAL 2009 REPORTING SUMMARY  
THE BOEING COMPANY  
SANTA SUSANA FIELD LABORATORY  
NPDES PERMIT CA0001309**

**Sample Date February 16, 2009**

ANALYTE	LAB LOD (ug/L)	LAB RL (ug/L)	LAB RESULT (ug/L)	VALIDATION QUALIFIER	1998 WHO TEF	TCDD Equivalent (w/out DNQ Values) (ug/L)
1,2,3,4,6,7,8-HpCDD	0.00E+00	2.50E-05	6.67E-05	--	0.01	6.67E-07
1,2,3,4,6,7,8-HpCDF	0.00E+00	2.50E-05	1.19E-05	J (DNQ)	0.01	ND
1,2,3,4,7,8,9-HpCDF	3.05E-06	2.50E-05	ND	U	0.01	ND
1,2,3,4,7,8-HxCDD	3.12E-06	2.50E-05	ND	U	0.1	ND
1,2,3,4,7,8-HxCDF	1.57E-06	2.50E-05	ND	U	0.1	ND
1,2,3,6,7,8-HxCDD	3.28E-06	2.50E-05	ND	U	0.1	ND
1,2,3,6,7,8-HxCDF	1.67E-06	2.50E-05	ND	U	0.1	ND
1,2,3,7,8,9-HxCDD	3.09E-06	2.50E-05	ND	U	0.1	ND
1,2,3,7,8,9-HxCDF	2.63E-06	2.50E-05	ND	U	0.1	ND
1,2,3,7,8-PeCDD	1.47E-06	2.50E-05	ND	U	1	ND
1,2,3,7,8-PeCDF	8.41E-07	2.50E-05	ND	U	0.05	ND
2,3,4,6,7,8-HxCDF	1.80E-06	2.50E-05	ND	U	0.1	ND
2,3,4,7,8-PeCDF	9.08E-07	2.50E-05	ND	U	0.5	ND
2,3,7,8-TCDD	6.71E-07	5.00E-06	ND	U	1	ND
2,3,7,8-TCDF	6.76E-07	5.00E-06	ND	U	0.1	ND
OCDD	0.00E+00	5.00E-05	6.43E-04	--	0.0001	6.43E-08
OCDF	0.00E+00	5.00E-05	4.12E-05	J (DNQ)	0.0001	ND
<b>TCDD TEQ w/out DNQ Values</b>						<b>7.31E-07</b>

**TCDD TEQ BENCHMARK LIMIT = 2.80E-08**

See attached notes for abbreviations, definitions, and other explanations for the data presented in this table.

**OUTFALL 001 (South Slope below Perimeter Pond)**

**ANNUAL 2009 REPORTING SUMMARY  
THE BOEING COMPANY  
SANTA SUSANA FIELD LABORATORY  
NPDES PERMIT CA0001309**

**January 1 through December 31, 2009**

ANALYTE	UNITS	Benchmark Limit Daily Max/Monthly Avg	2/16/2009		
			RESULT	MDA	VALIDATION QUALIFIER
<b>RADIOACTIVITY</b>					
Gross Alpha	pCi/L	15/-	5.5 ± 1.6	1.1	J (H,C)
Gross Beta	pCi/L	50/-	4.9 ± 1.1	1.2	J (H)
Strontium-90	pCi/L	8.0/-	0.06 ± 0.28	0.49	U
Total Combined Radium-226 & Radium 228	pCi/L	5.0/-	0.48 ± 0.39	0.80	U
Tritium	pCi/L	20000/-	-50 ± 170	300	U
Uranium, Total	pCi/L	20/-	0.547 ± 0.066	0.42	J (H,DNQ)
Potassium-40	pCi/L	-/-	-80 ± 1600	300	UJ (H)
Cesium 137	pCi/L	200/-	2.6 ± 9.8	18	UJ (H)



**OUTFALL 001 (South Slope below Perimeter Pond)**

**ANNUAL 2009 REPORTING SUMMARY  
THE BOEING COMPANY  
SANTA SUSANA FIELD LABORATORY  
NPDES PERMIT CA0001309**

January 1 through December 31, 2009

ANALYTE	UNITS	Benchmark Limit Daily Max/Monthly Avg	2/16/2009	
			Result	CONCENTRATION RESULT VALIDATION QUALIFIER
Ammonia as Nitrogen (N)	LBS/DAY	13,500/2615	0.92	*
Biochemical Oxygen Demand (BOD 5 day)	LBS/DAY	40,032/26,700	3.94	*
Chloride	LBS/DAY	200,160/-	16.43	*
Surfactants (MBAS)	LBS/DAY	667/-	0.16	J* (DNQ)
Fluoride	LBS/DAY	2,135/-	0.20	B*
Nitrate + Nitrite as Nitrogen (N)	LBS/DAY	10,700/-	2.30	*
Nitrate as Nitrogen (N)	LBS/DAY	10,700/-	2.30	*
Nitrite-N	LBS/DAY	1,334/-	ND	*
Oil and Grease	LBS/DAY	20,016/13,344	3.12	J* (DNQ)
Perchlorate	LBS/DAY	8/-	ND	*
Sulfate	LBS/DAY	400,320/-	15.94	*
Total Cyanide	LBS/DAY	11.3/5.7	ND	*
Total Dissolved Solids	LBS/DAY	1,270,000/-	197.18	*
Total Residual Chlorine	LBS/DAY	133/-	ND	HFT*
Total Suspended Solids	LBS/DAY	60,048/20,016	151.17	--
Antimony	LBS/DAY	8.01/-	ND	U (B)
Arsenic	LBS/DAY	66.7/-	ND	U
Barium	LBS/DAY	1,330/-	0.12	--
Beryllium	LBS/DAY	5.34/-	ND	U
Cadmium	LBS/DAY	4.14/2.7	0.0002	J (DNQ)
Chromium IV	LBS/DAY	21.8/10.8	ND	*
Copper	LBS/DAY	18.7/9.5	0.01	J (*III)
Iron	LBS/DAY	400/-	13.31	--
Lead	LBS/DAY	6.94/3.5	0.01	--
Manganese	LBS/DAY	66.7/-	0.18	--
Mercury	LBS/DAY	0.13/0.07	ND	U
Nickel	LBS/DAY	128/47	ND	U (B)
Selenium	LBS/DAY	10.9/5.5	0.001	J (*III, DNQ)
Silver	LBS/DAY	5.5/2.7	ND	U
Thallium	LBS/DAY	2.7/-	ND	U
Zinc	LBS/DAY	159/72	0.06	--
1,1-Dichloroethene	LBS/DAY	8/4.3	ND	*
Trichloroethene	LBS/DAY	6.7/-	ND	*
2,4,6-Trichlorophenol	LBS/DAY	17/8.7	ND	U
2,4-Dinitrotoluene	LBS/DAY	24/12	ND	U
alpha-BHC	LBS/DAY	0.04/0.013	ND	UJ (H)
bis (2-ethylhexyl) Phthalate	LBS/DAY	5.3/-	ND	U
n-Nitrosodimethylamine	LBS/DAY	21.8/10.8	ND	U
Pentachlorophenol	LBS/DAY	22/10.9	0.002	J (DNQ)
TCDD TEQ_NoDNQ	LBS/DAY	3.70E-08/1.90E-08	1.20E-09	--


**OUTFALL 001 (South Slope below Perimeter Pond)**

**ANNUAL 2009 REPORTING SUMMARY  
THE BOEING COMPANY  
SANTA SUSANA FIELD LABORATORY  
NPDES PERMIT CA0001309**


**January 1 through December 31, 2009**

<b>ANALYTE</b>	<b>UNITS</b>	<b>Benchmark Limit Monthly Avg</b>	<b>February Average Mass Loading (lbs/day)</b>
Ammonia as Nitrogen (N)	LBS/DAY	2615	0.93
Biochemical Oxygen Demand (BOD 5 day)	LBS/DAY	26,700	3.99
Oil and Grease	LBS/DAY	13,344	3.16
Total Cyanide	LBS/DAY	5.7	ND
Total Suspended Solids	LBS/DAY	20,016	152.92
<b>METALS</b>			
Cadmium	LBS/DAY	2.7	0.0002
Chromium IV	LBS/DAY	10.8	ND
Copper	LBS/DAY	9.5	0.01
Lead	LBS/DAY	3.5	0.01
Mercury	LBS/DAY	0.07	ND
Nickel	LBS/DAY	47	ND
Selenium	LBS/DAY	5.5	0.001
Silver	LBS/DAY	2.7	ND
Zinc	LBS/DAY	72	0.06
<b>ORGANICS</b>			
1,1-Dichloroethene	LBS/DAY	4.3	ND
<b>ADDITIONAL ANALYTES</b>			
2,4,6-Trichlorophenol	LBS/DAY	8.7	ND
2,4-Dinitrotoluene	LBS/DAY	12	ND
alpha-BHC	LBS/DAY	0.013	ND
n-Nitrosodimethylamine	LBS/DAY	10.8	ND
Pentachlorophenol	LBS/DAY	10.9	0.002
TCDD TEQ_NoDNQ	LBS/DAY	1.90E-08	1.22E-09


### 2009: OUTFALL 001 ANTIMONY

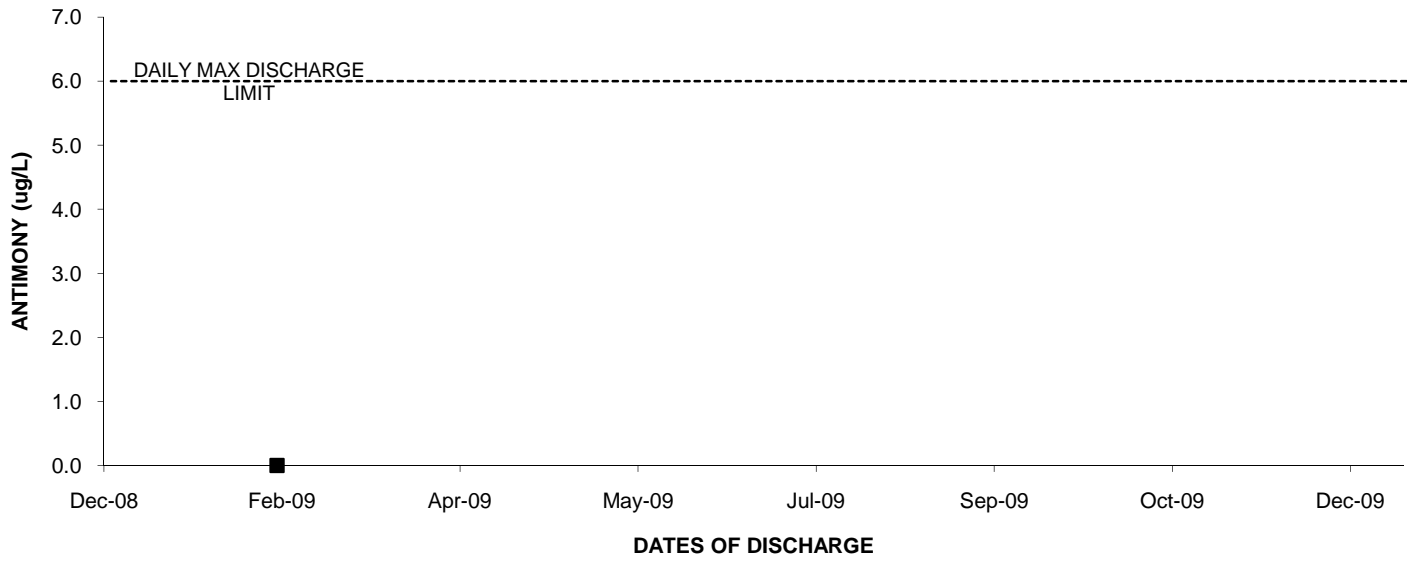


### 2009: OUTFALL 001 ARSENIC

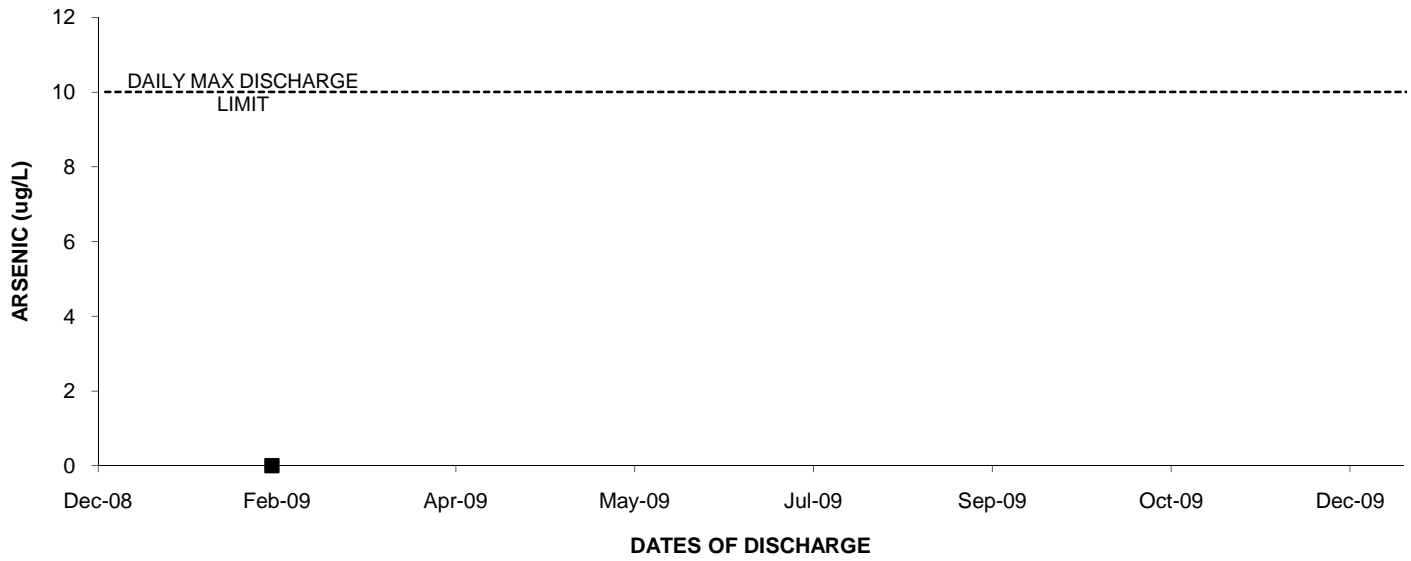


### 2009: OUTFALL 001 BARIUM

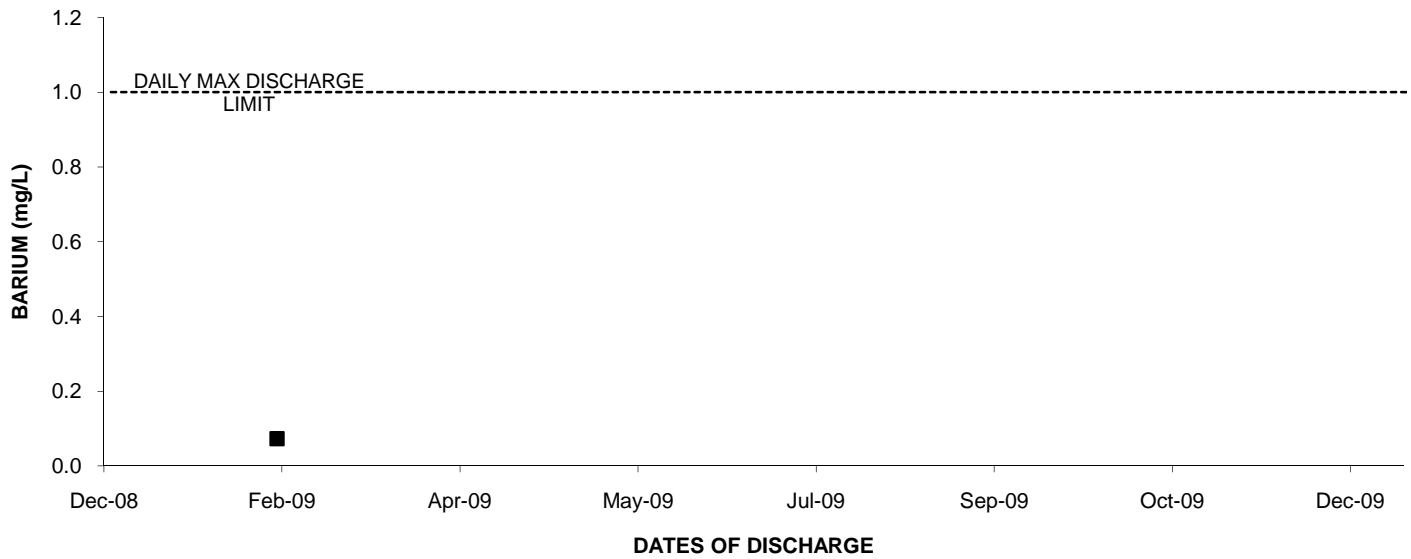


### 2009: OUTFALL 001 BERYLLIUM

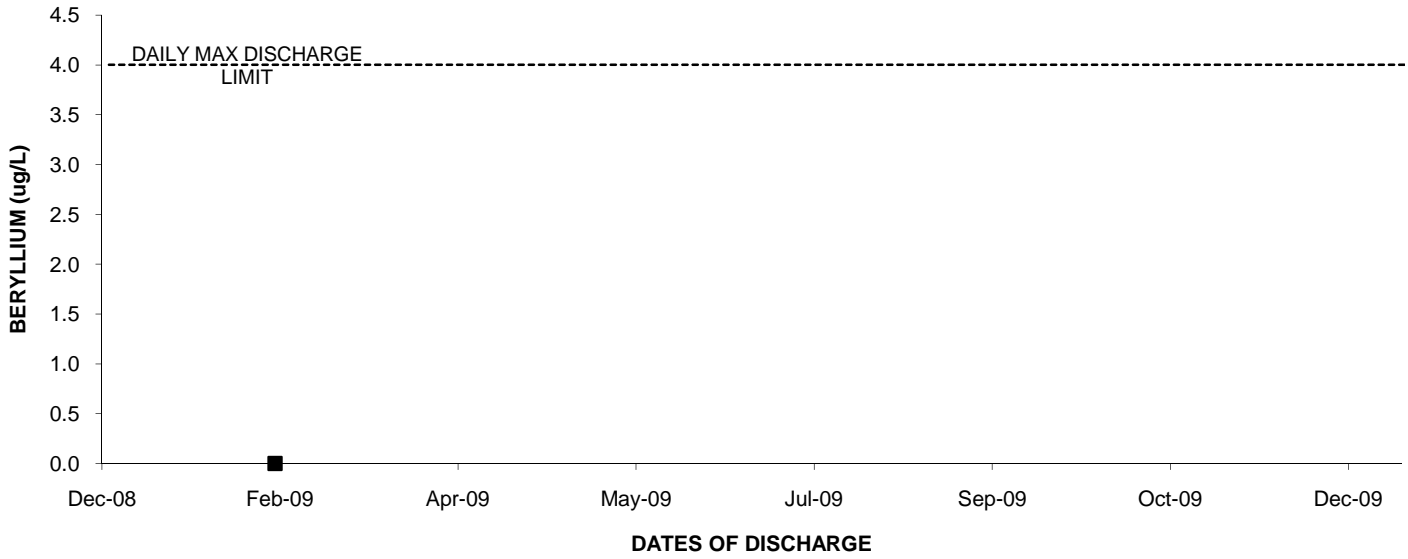


### 2009: OUTFALL 001 CADMIUM

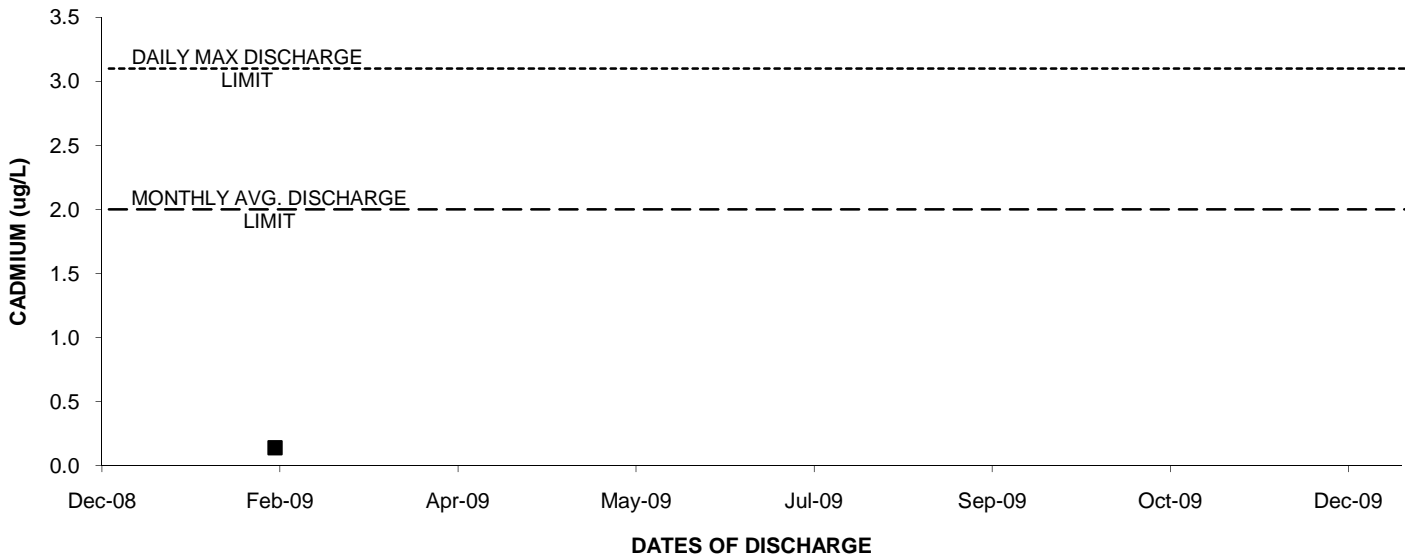


### 2009: OUTFALL 001 CHROMIUM

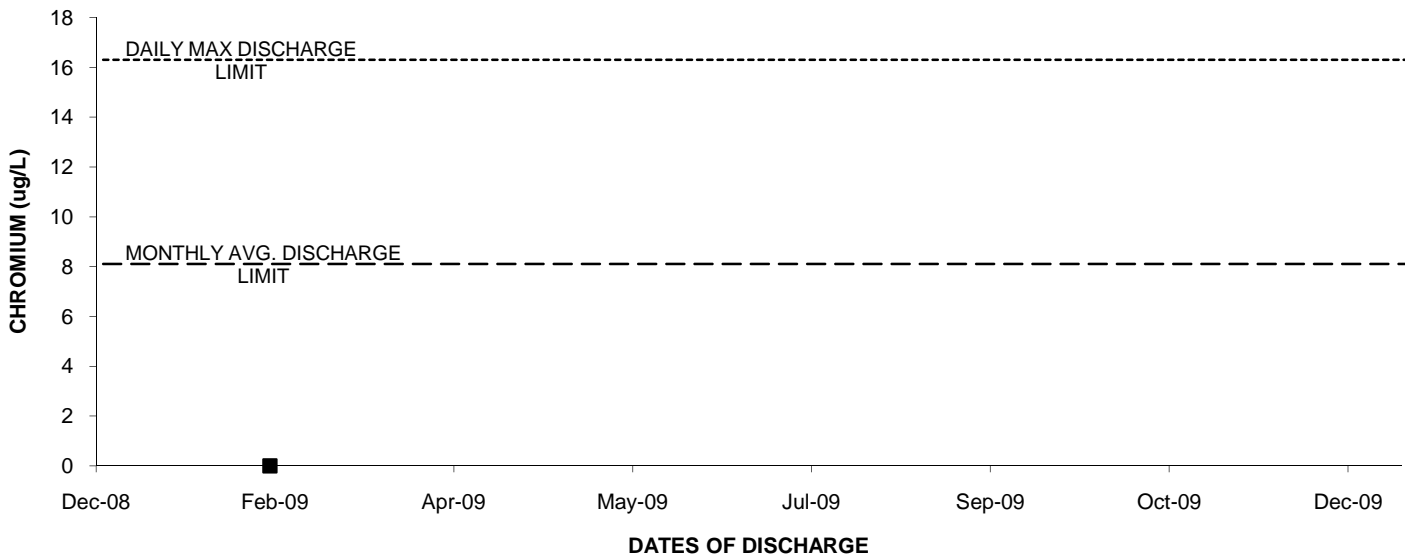


### 2009: OUTFALL 001 COPPER

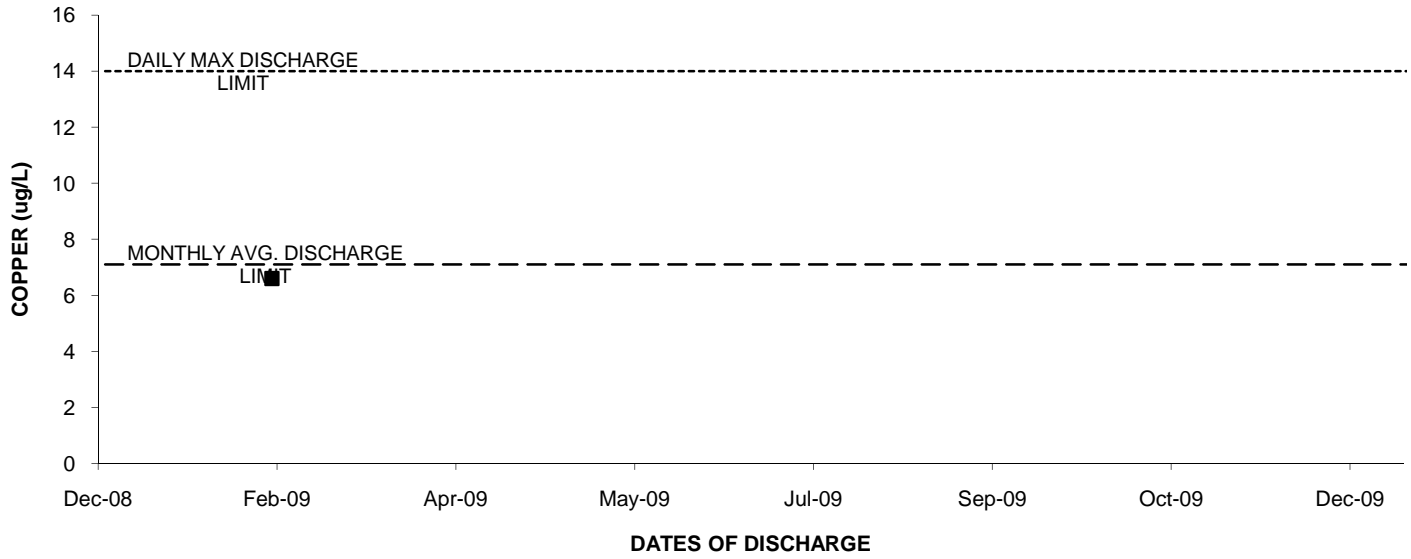


### 2009: OUTFALL 001 IRON

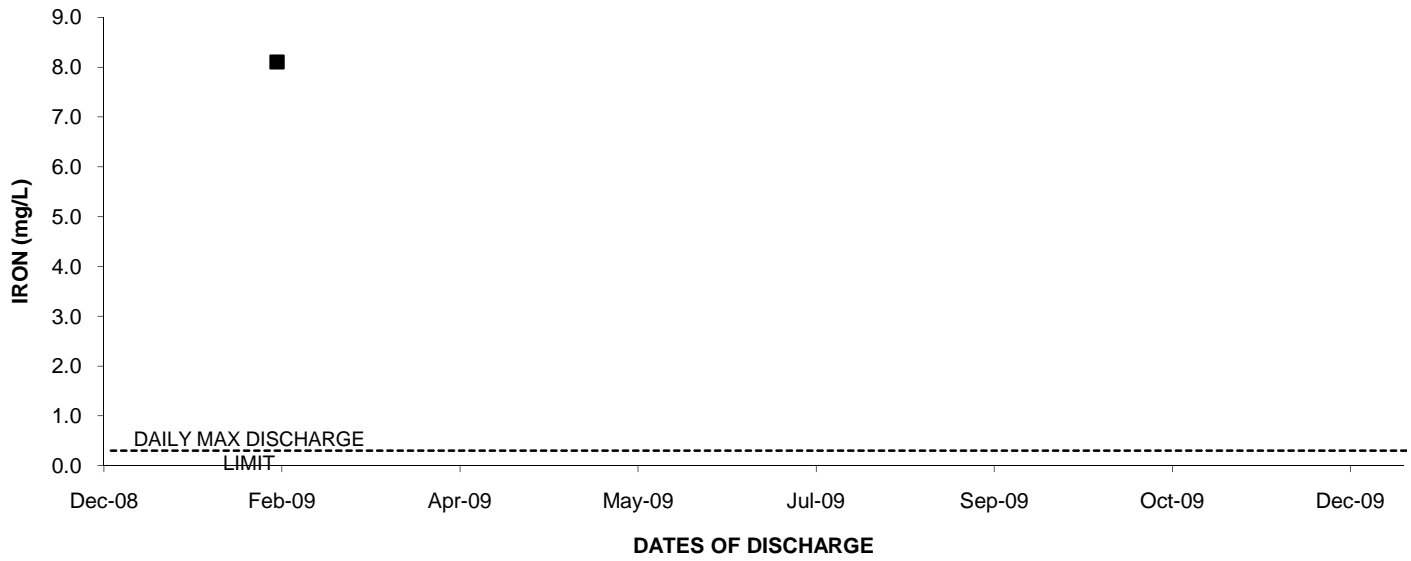


### 2009: OUTFALL 001 LEAD

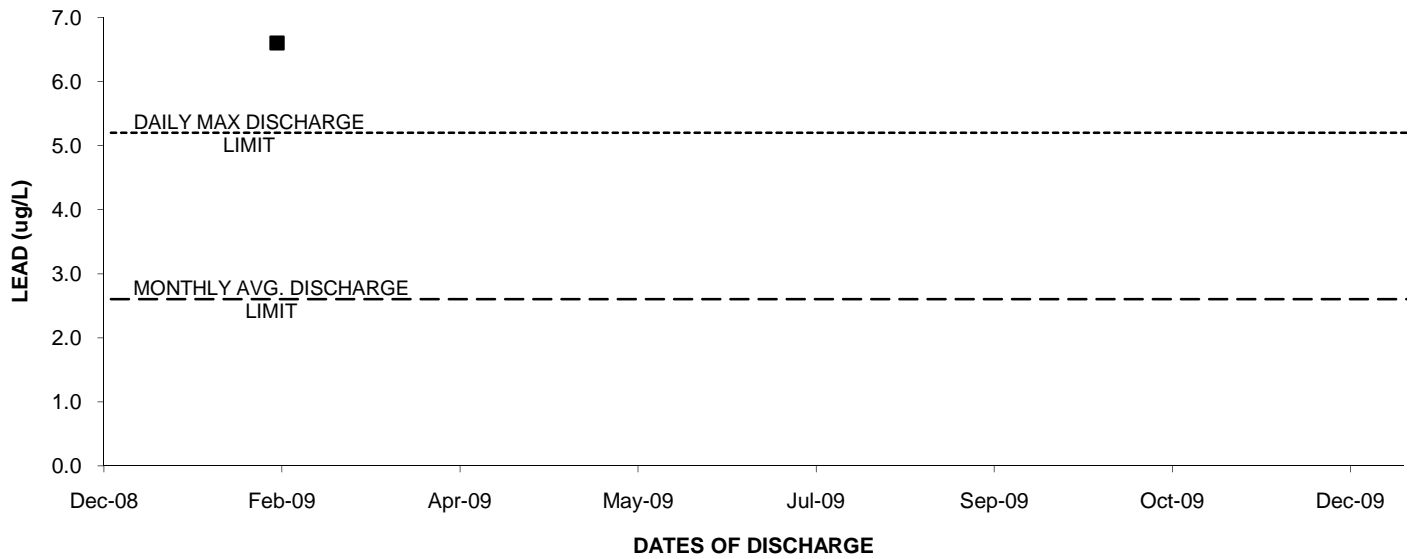


### 2009: OUTFALL 001 MANGANESE

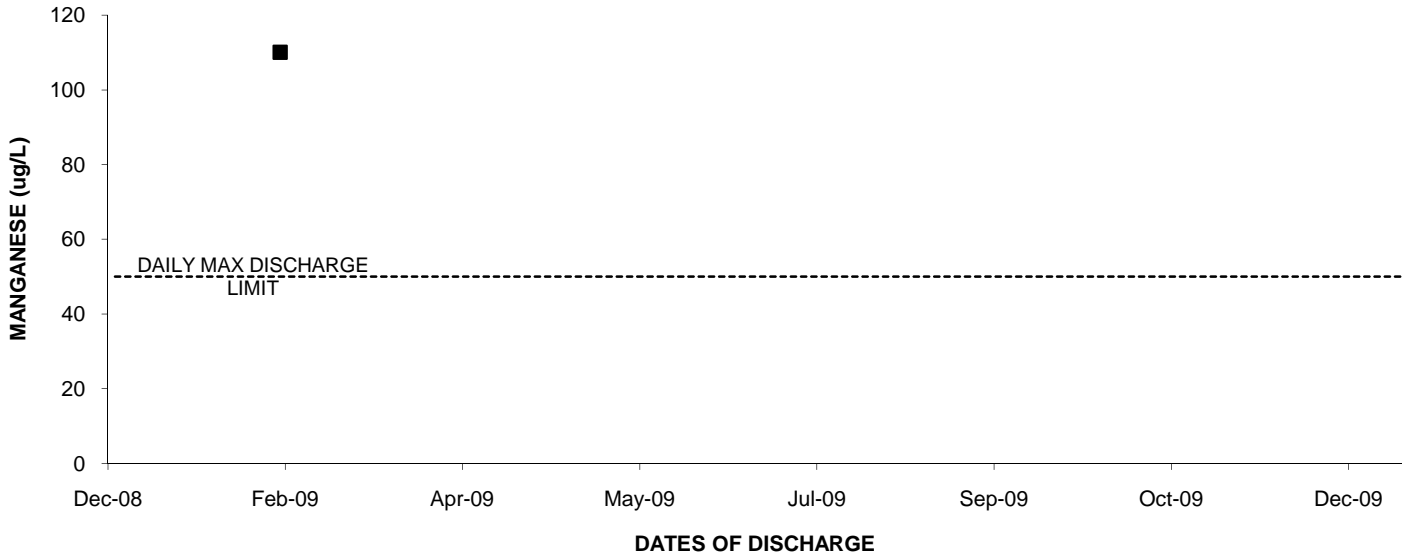


### 2009: OUTFALL 001 MERCURY

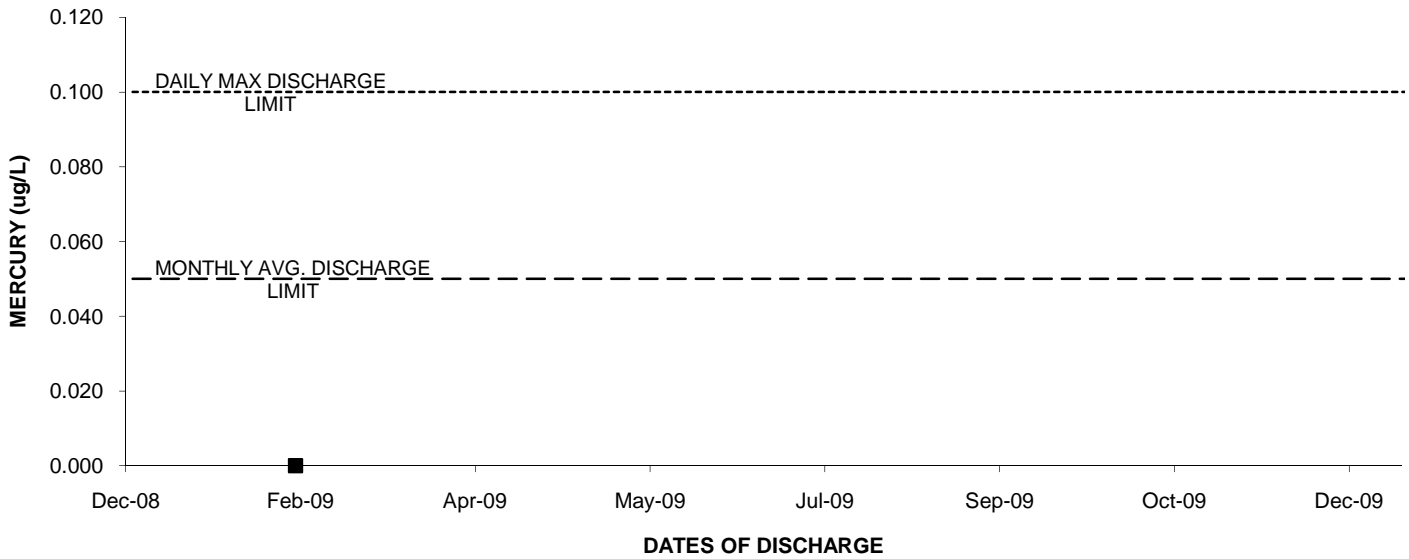


### 2009: OUTFALL 001 NICKEL

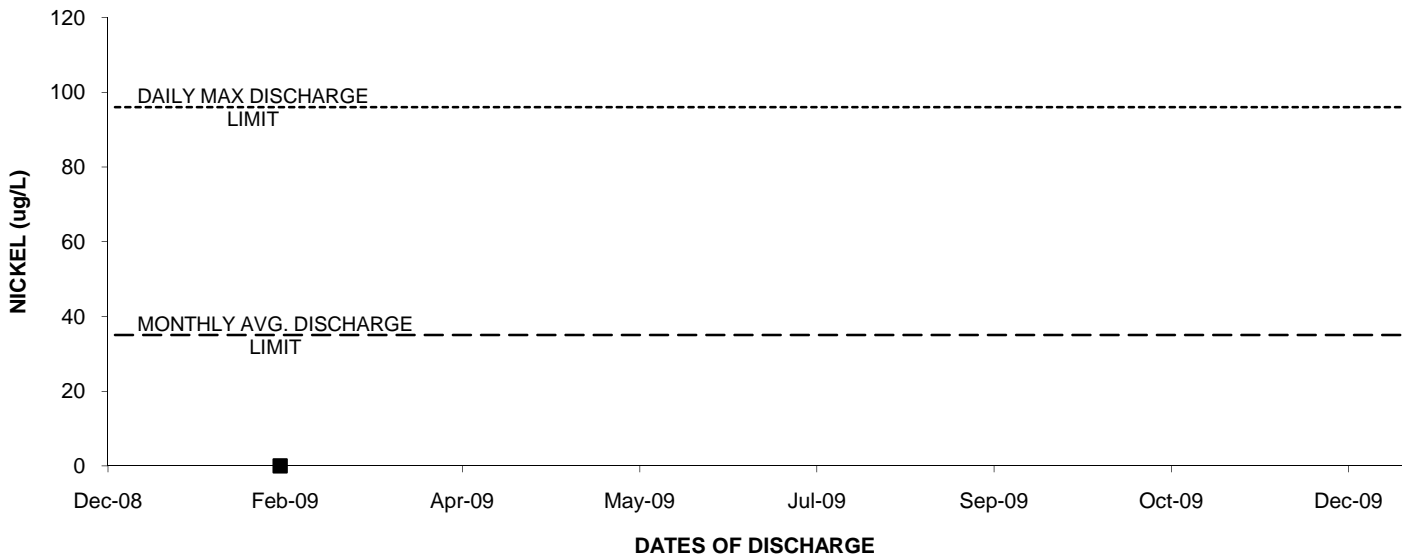


### 2009: OUTFALL 001 SELENIUM

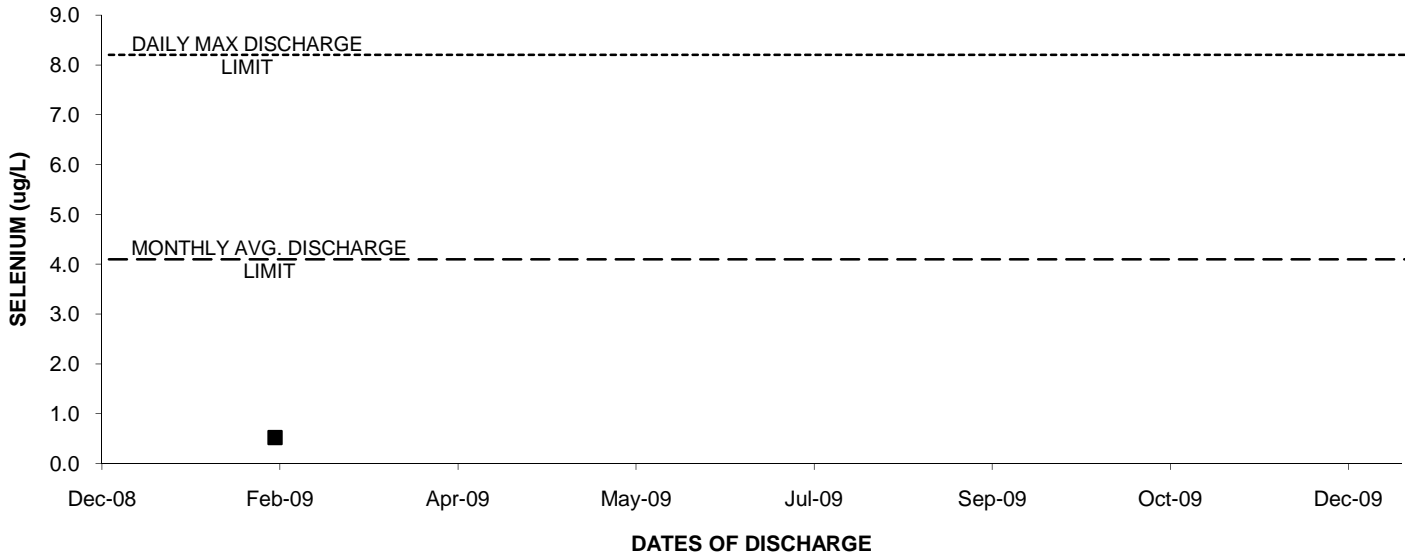


### 2009: OUTFALL 001 SILVER

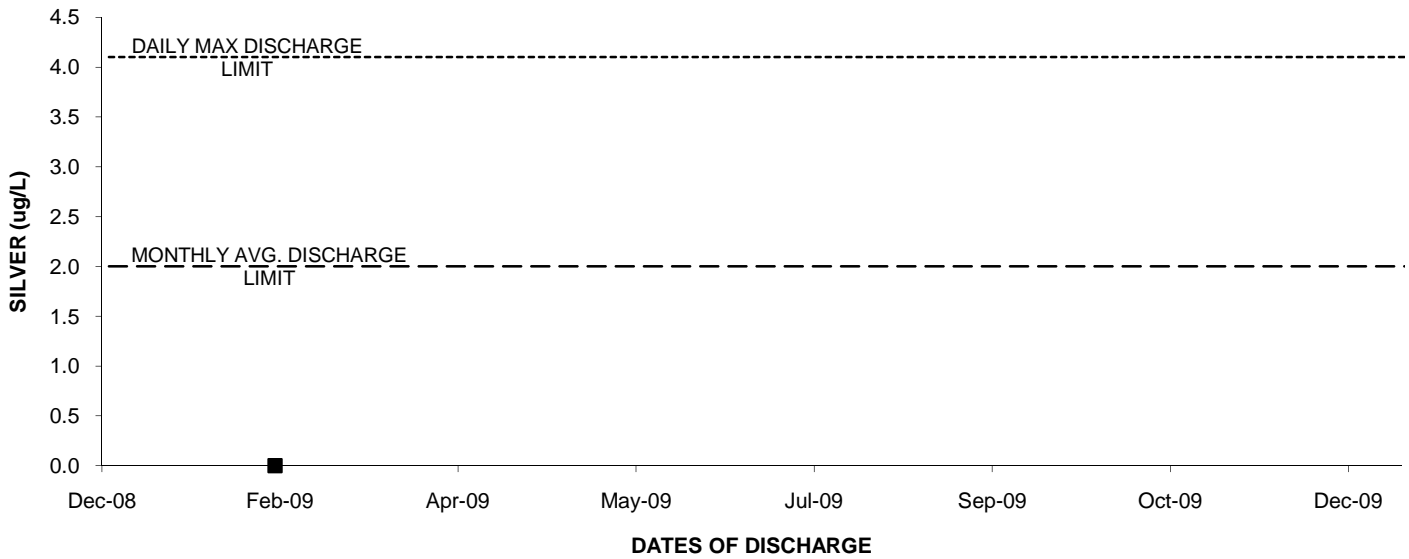


### 2009: OUTFALL 001 THALLIUM

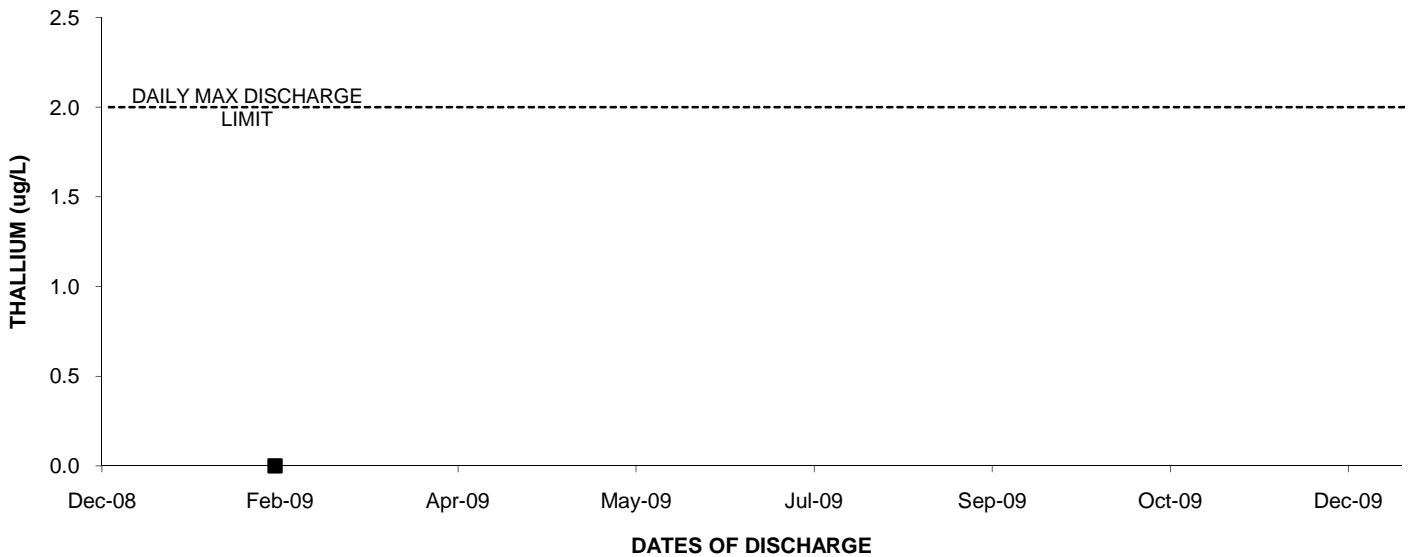


### 2009: OUTFALL 001 ZINC

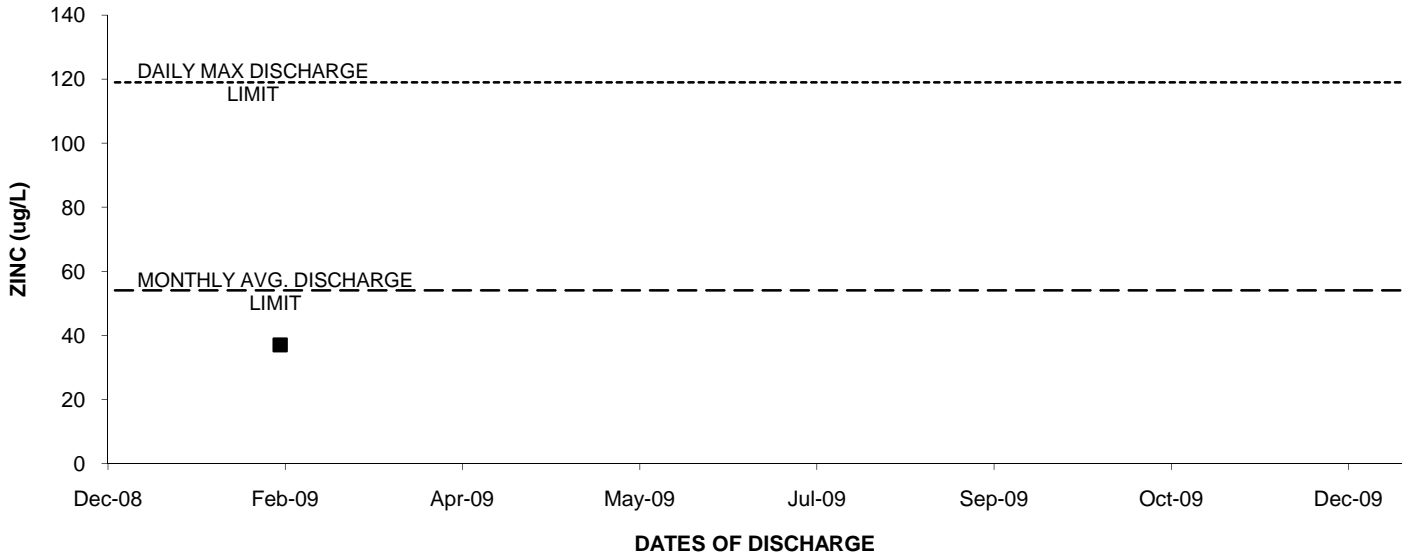

### 2009: OUTFALL 001 ACUTE TOXICITY

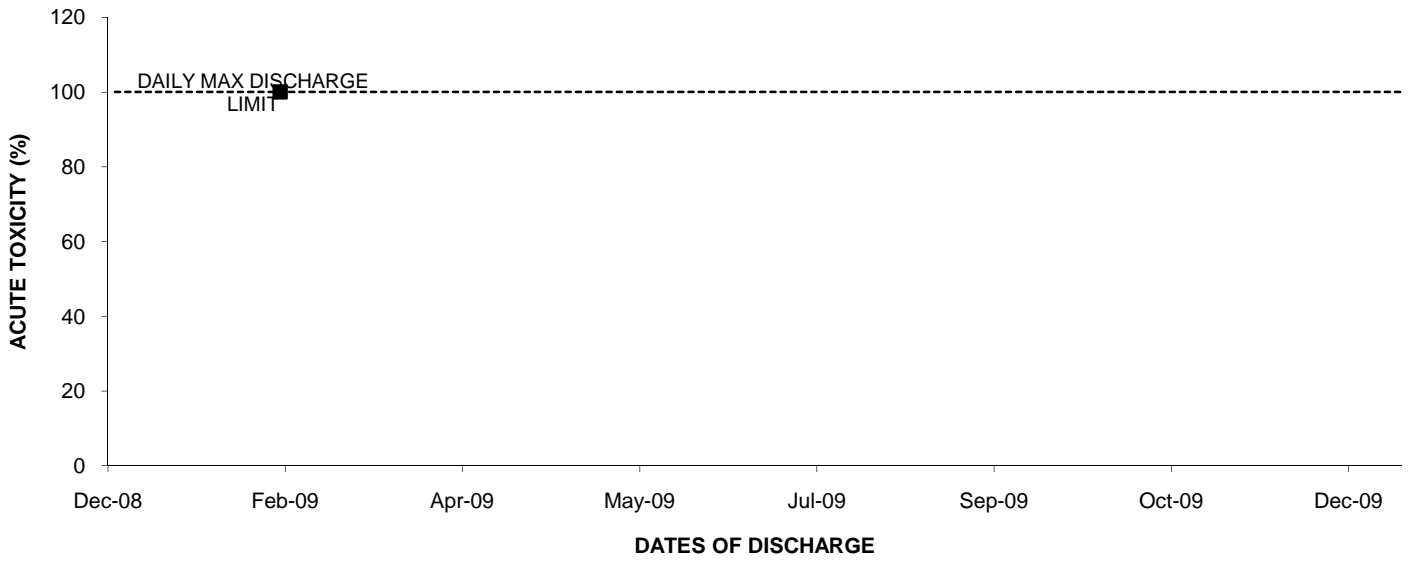


### 2009: OUTFALL 001 AMMONIA AS NITROGEN (N)

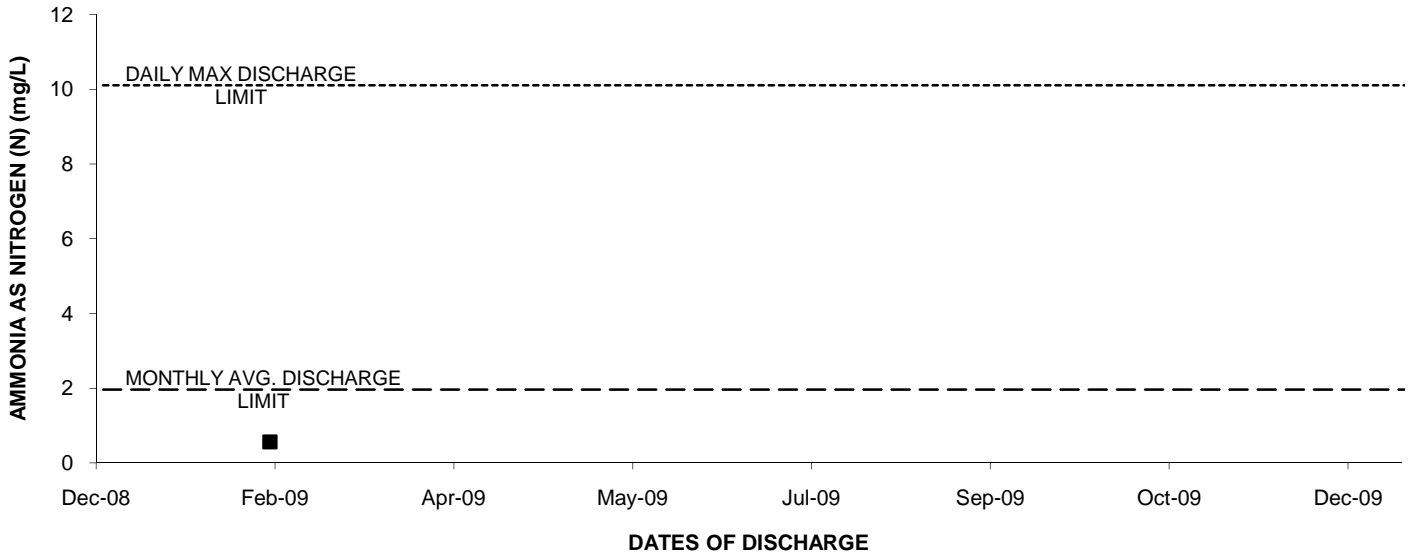





### 2009: OUTFALL 001 BIOCHEMICAL OXYGEN DEMAND (BOD 5 DAY)

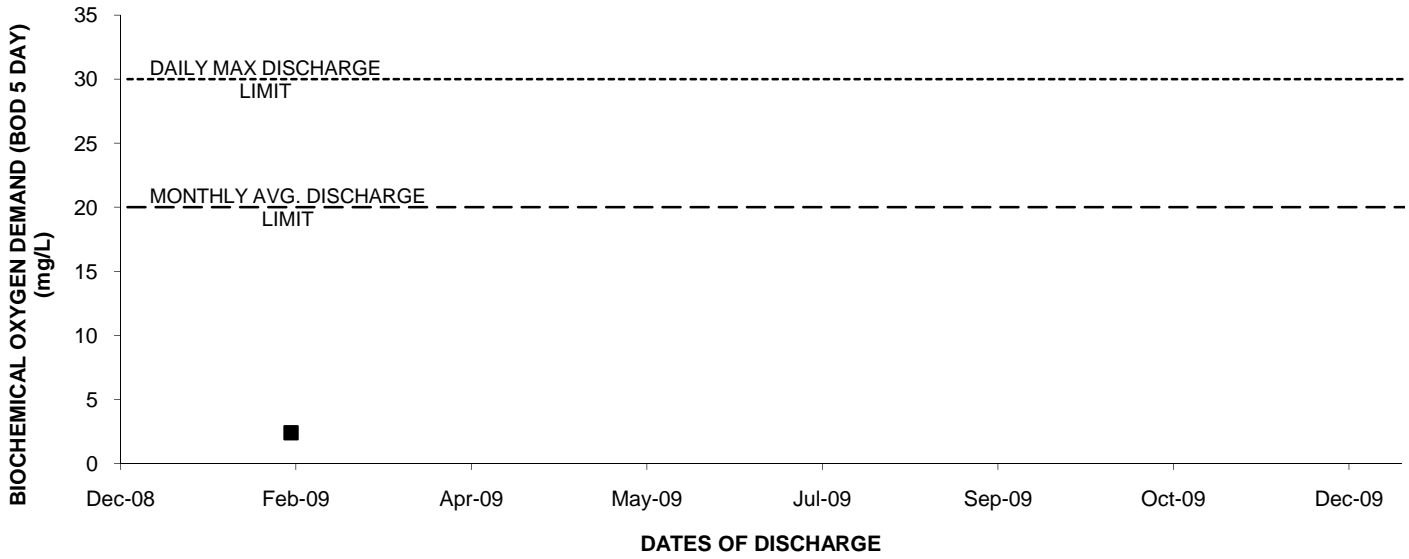


### 2009: OUTFALL 001 CHLORIDE

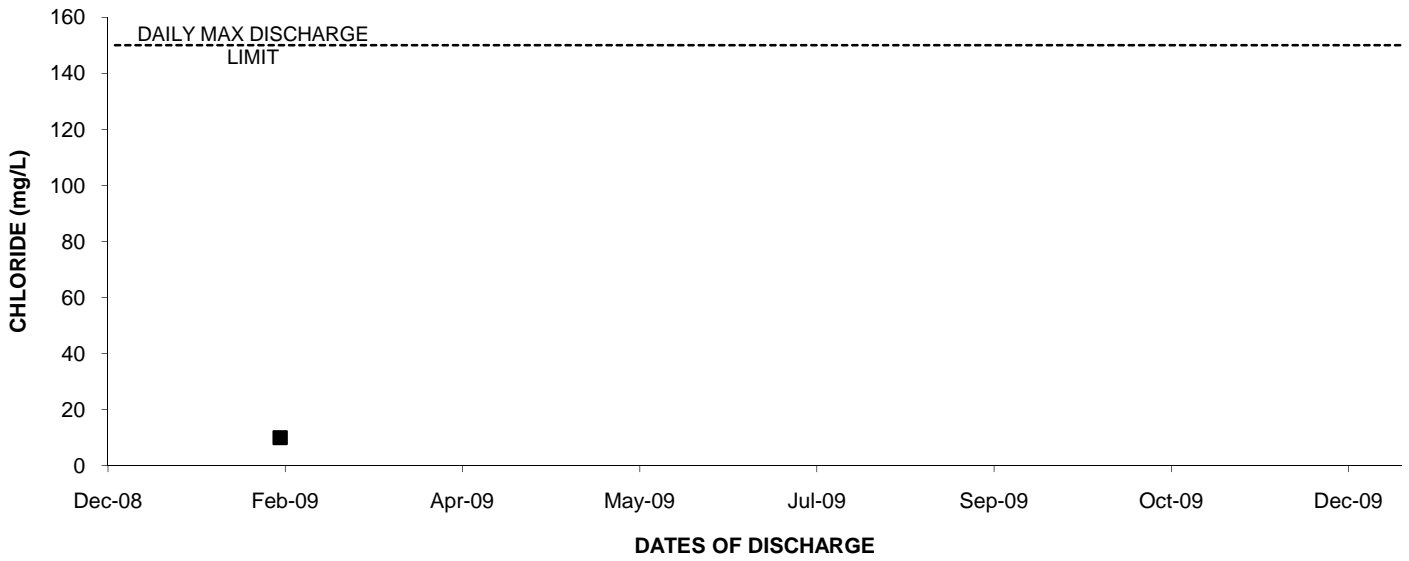


### 2009: OUTFALL 001 CHROMIUM VI

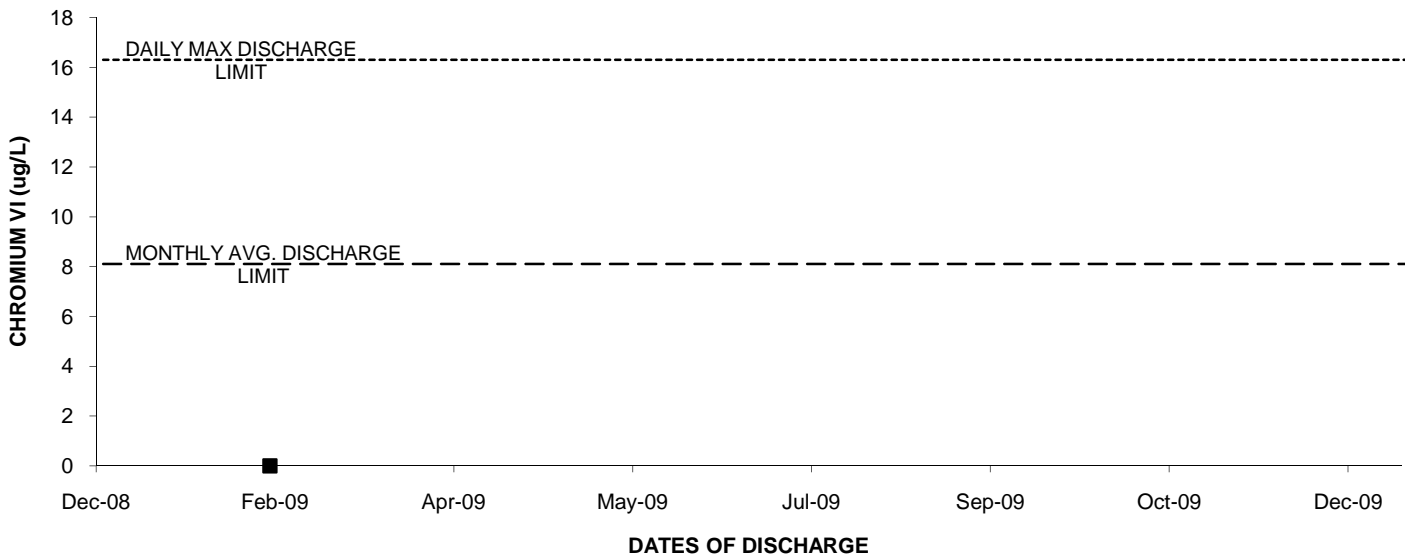


### 2009: OUTFALL 001 CHRONIC TOXICITY

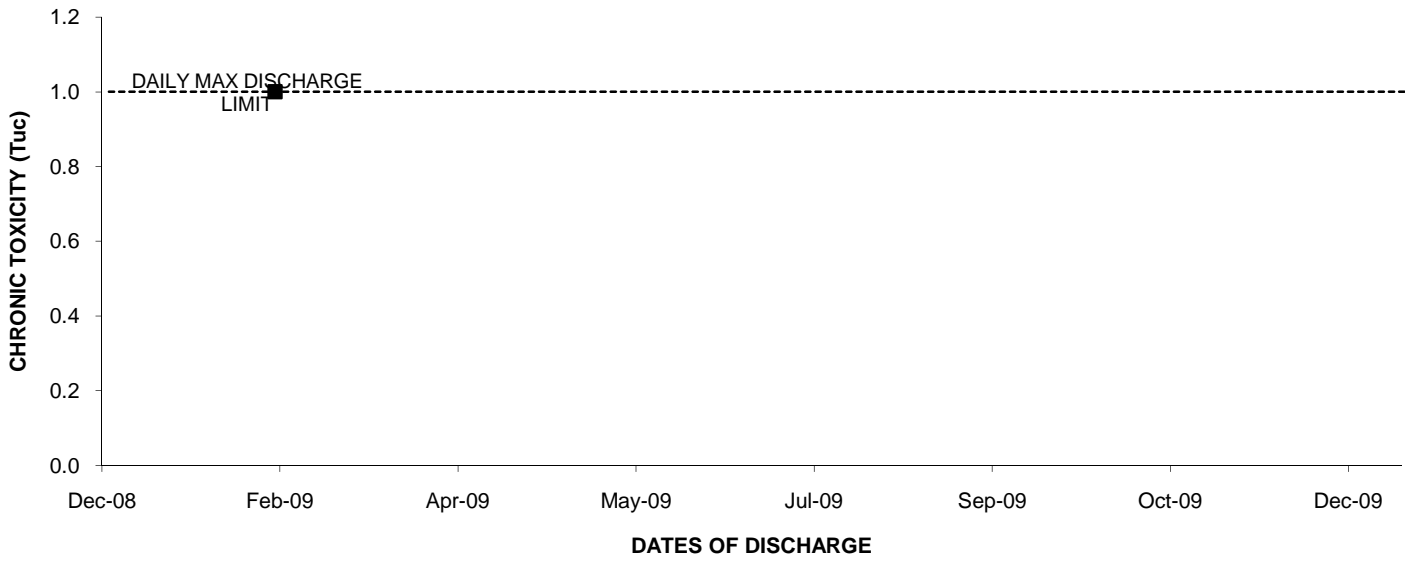


### 2009: OUTFALL 001 FLUORIDE

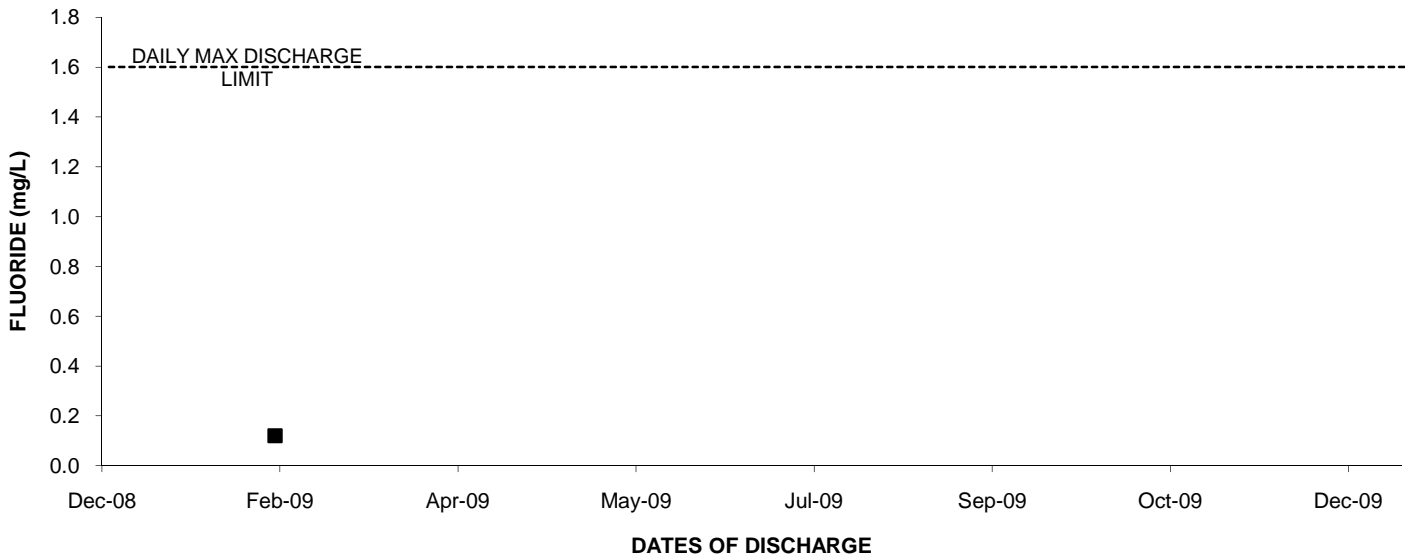


### 2009: OUTFALL 001 NITRATE + NITRITE AS NITROGEN (N)

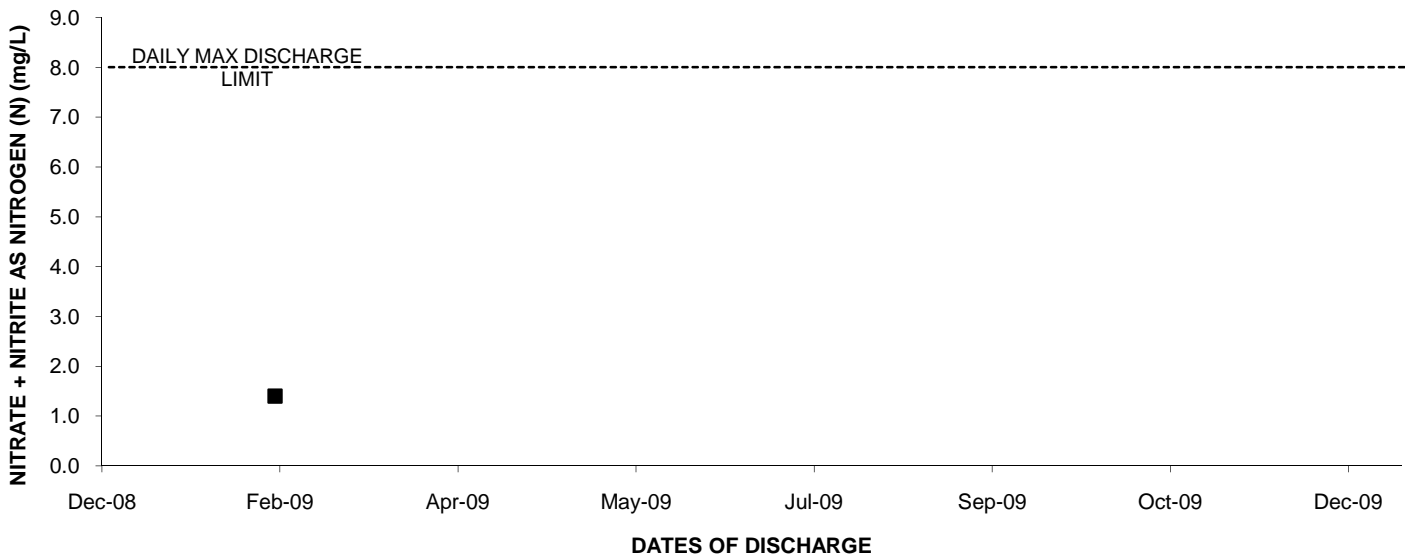


### 2009: OUTFALL 001 NITRATE AS NITROGEN (N)

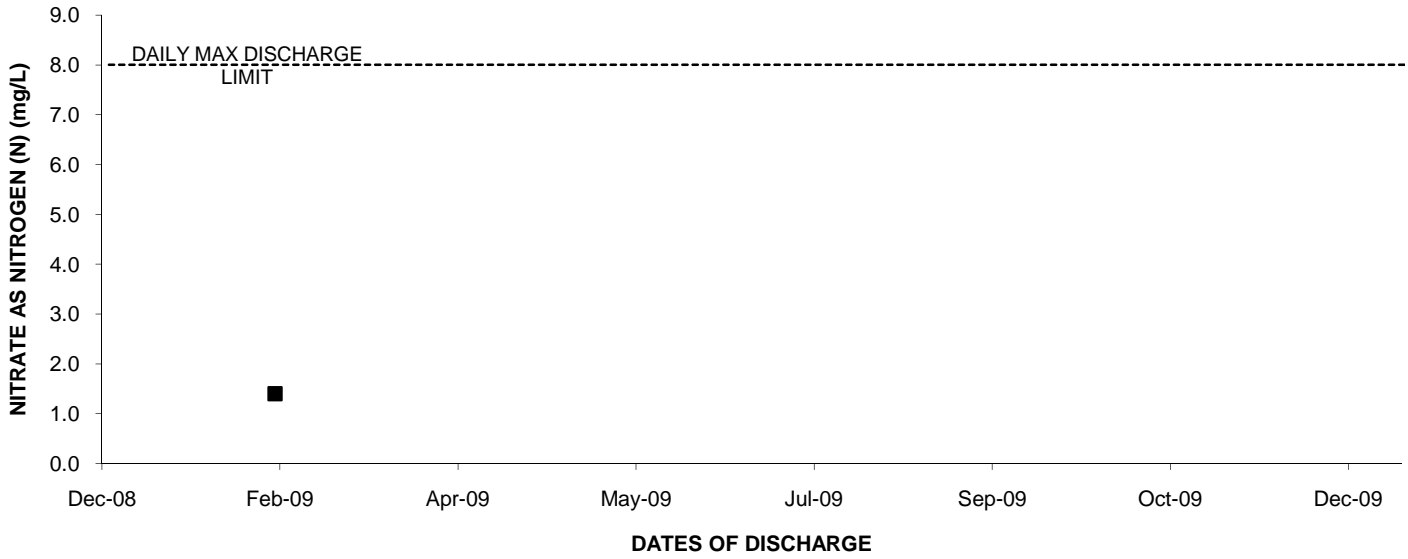


### 2009: OUTFALL 001 NITRITE-N

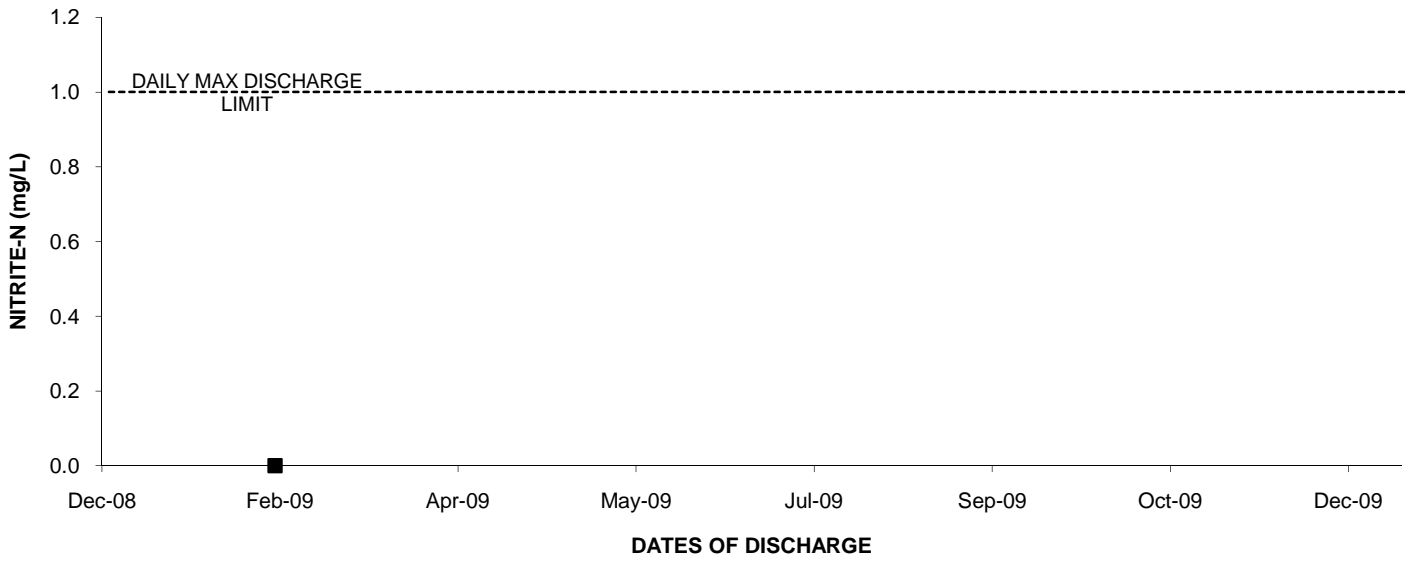


### 2009: OUTFALL 001 OIL & GREASE

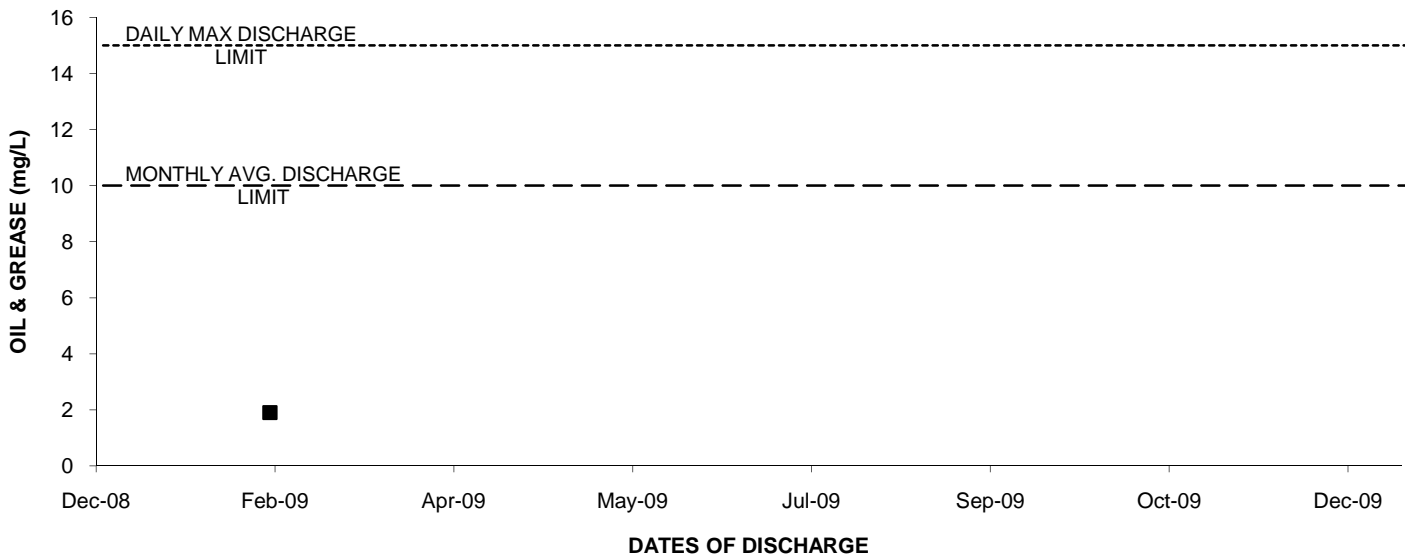


### 2009: OUTFALL 001 PERCHLORATE

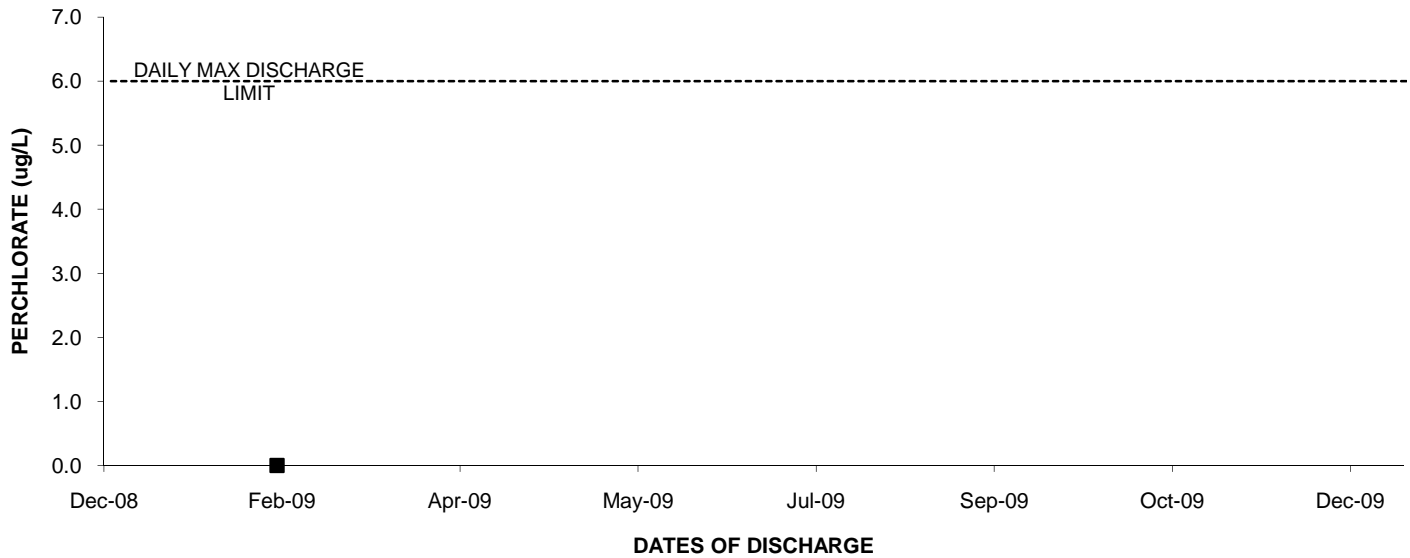


### 2009: OUTFALL 001 PH (FIELD)

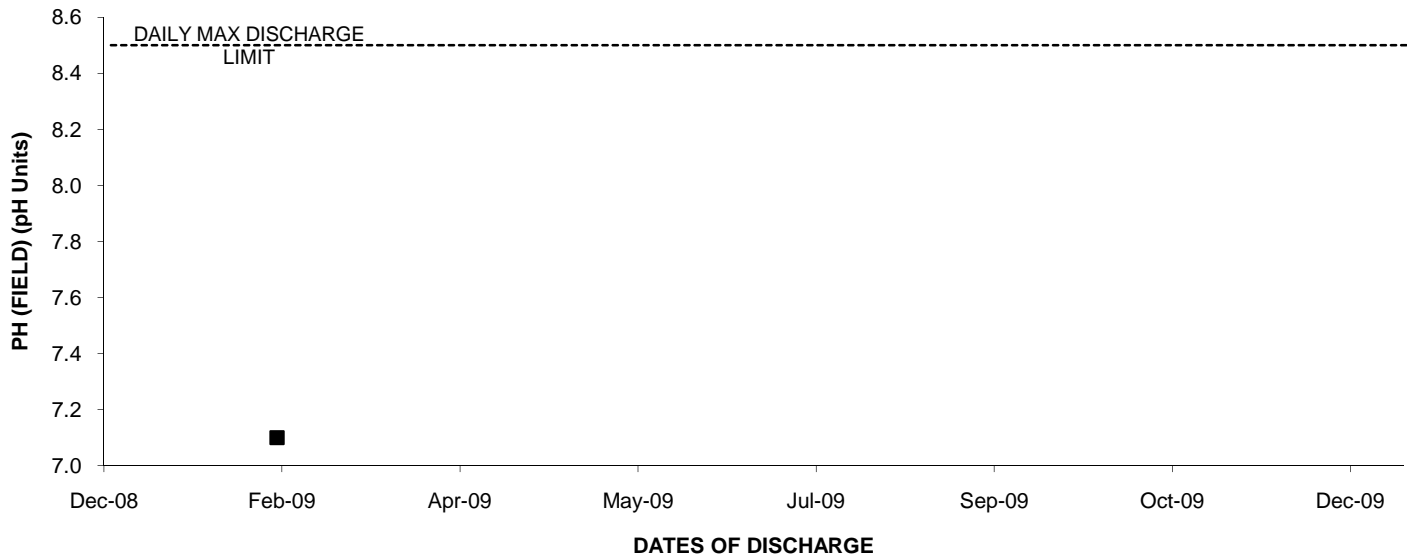


### 2009: OUTFALL 001 SULFATE

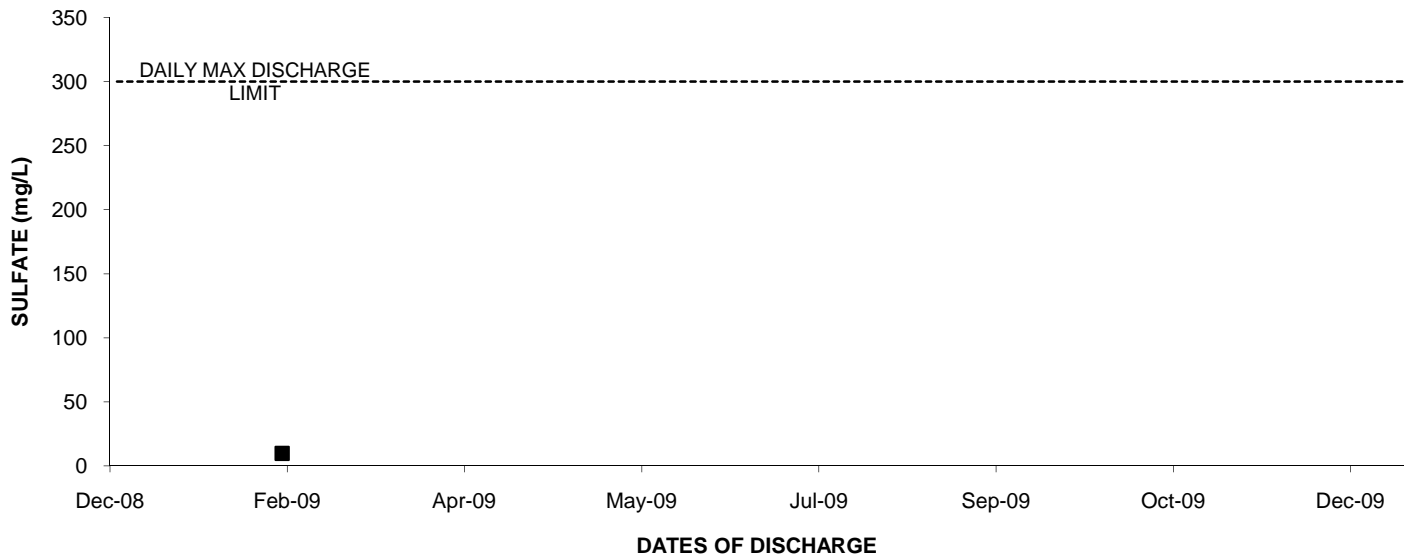


### 2009: OUTFALL 001 SURFACTANTS (MBAS)

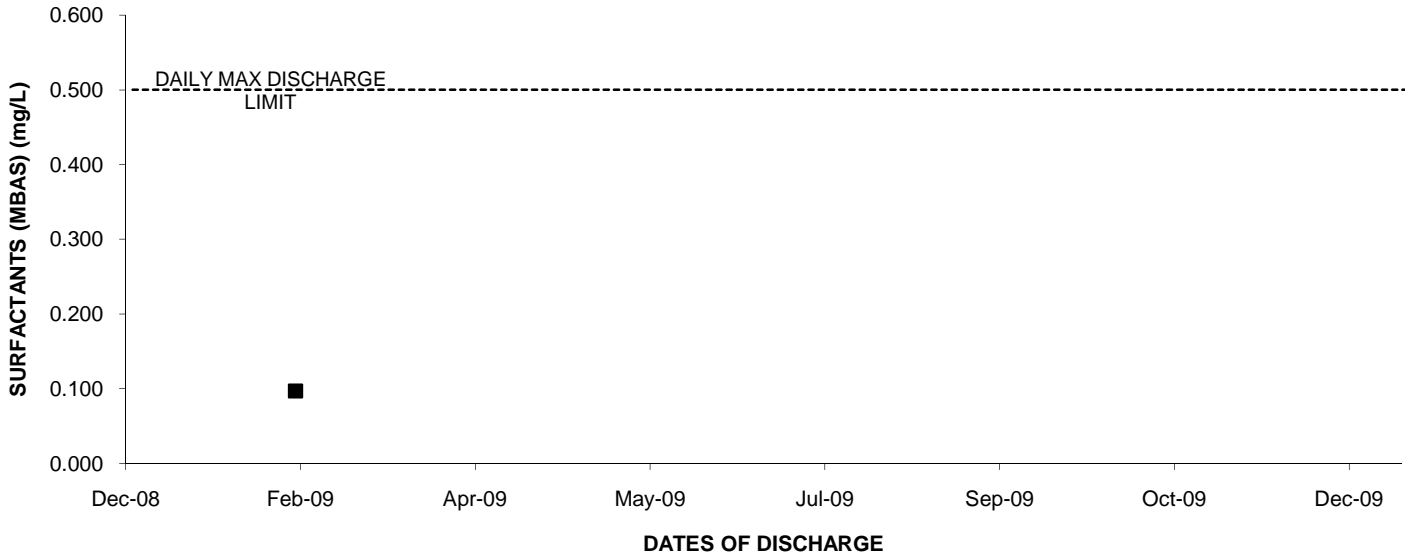


### 2009: OUTFALL 001 TEMPERATURE

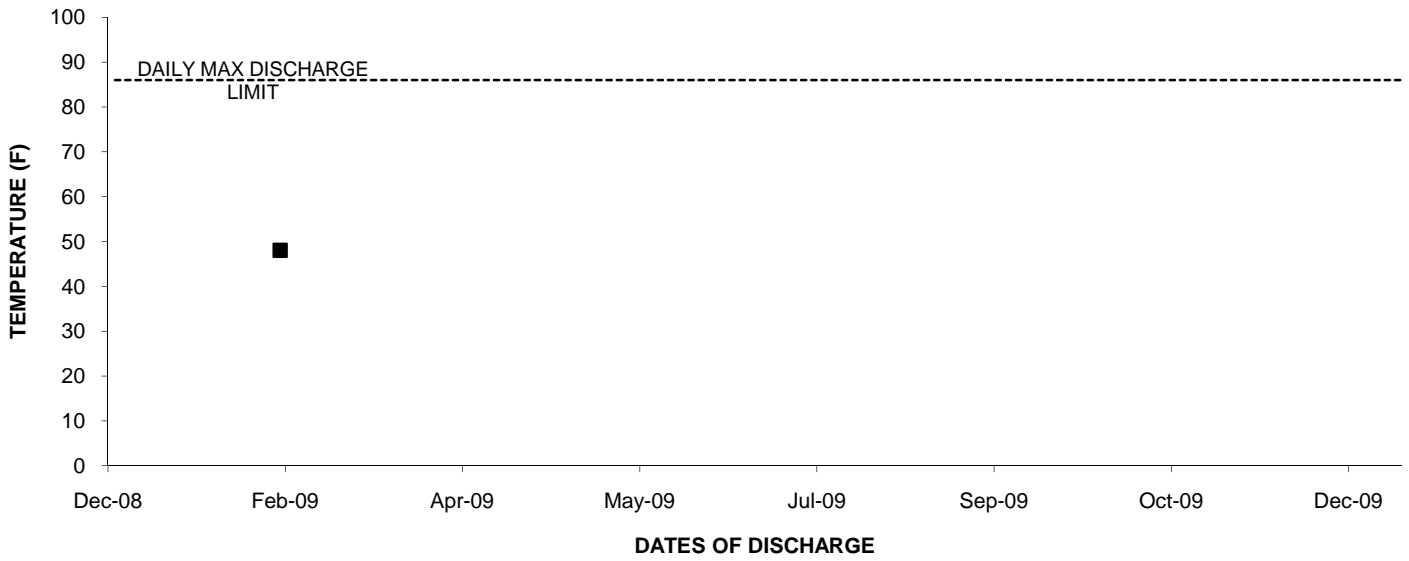


### 2009: OUTFALL 001 TOTAL CYANIDE

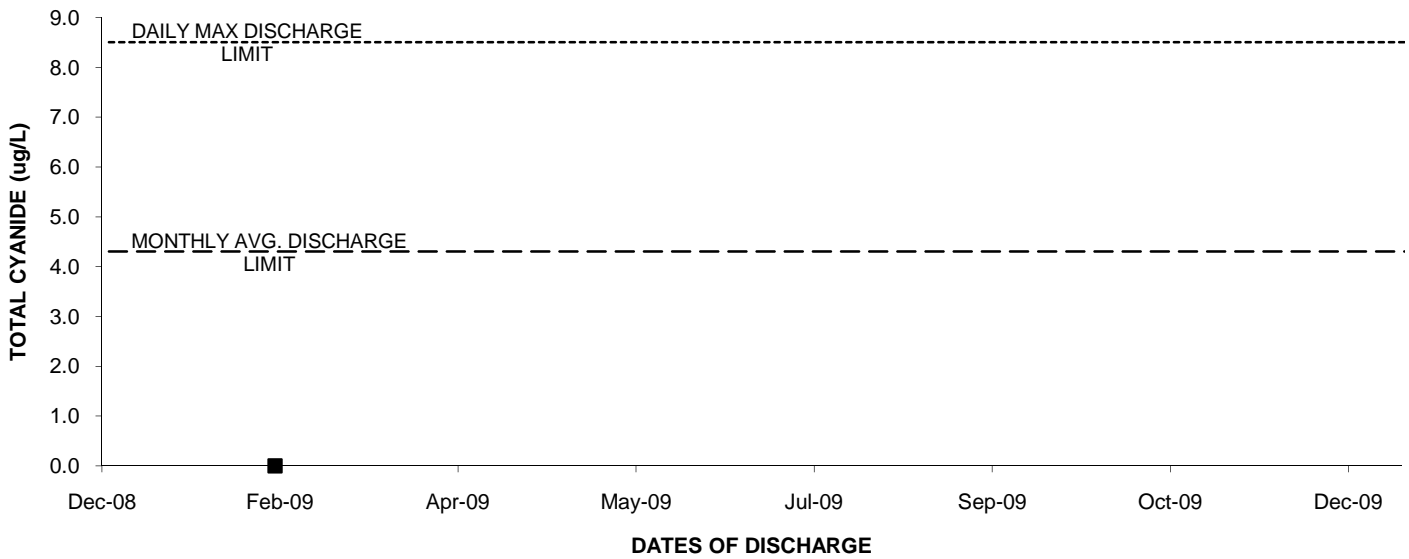


### 2009: OUTFALL 001 TOTAL DISSOLVED SOLIDS

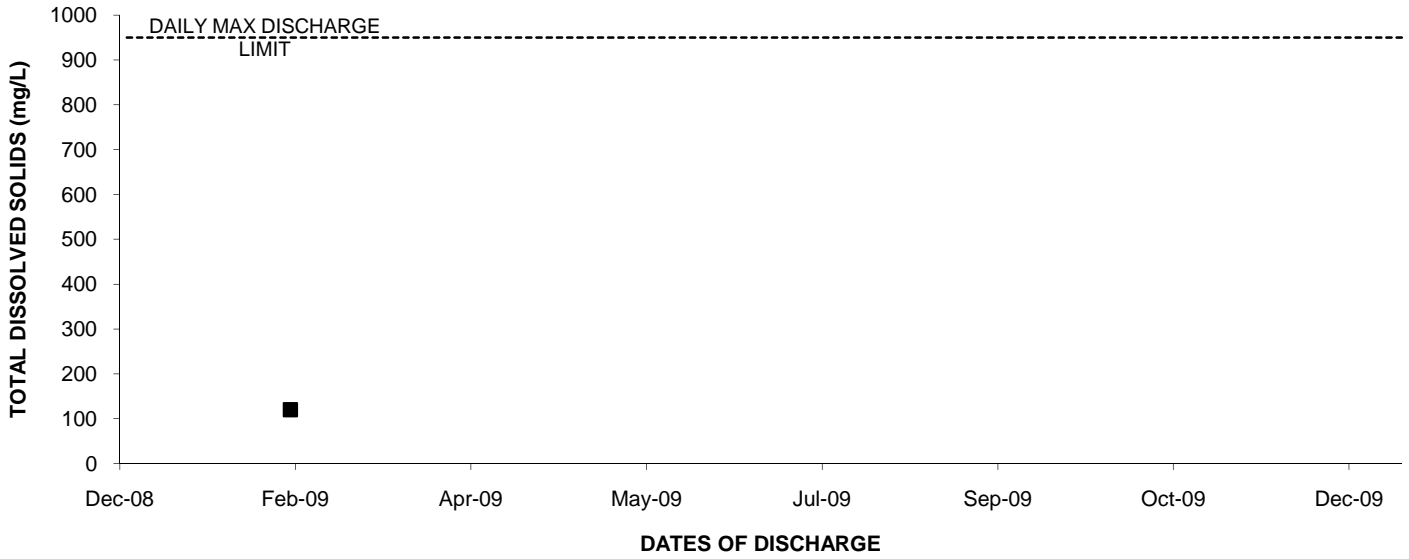


### 2009: OUTFALL 001 TOTAL RESIDUAL CHLORINE

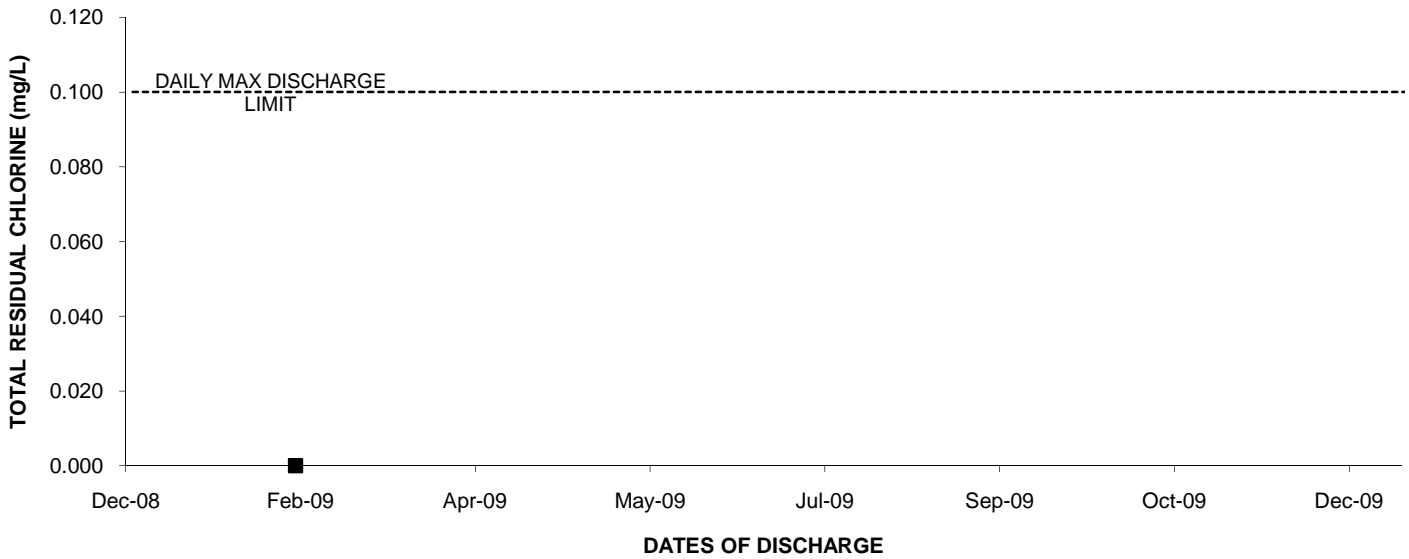


### 2009: OUTFALL 001 TOTAL SETTLEABLE SOLIDS

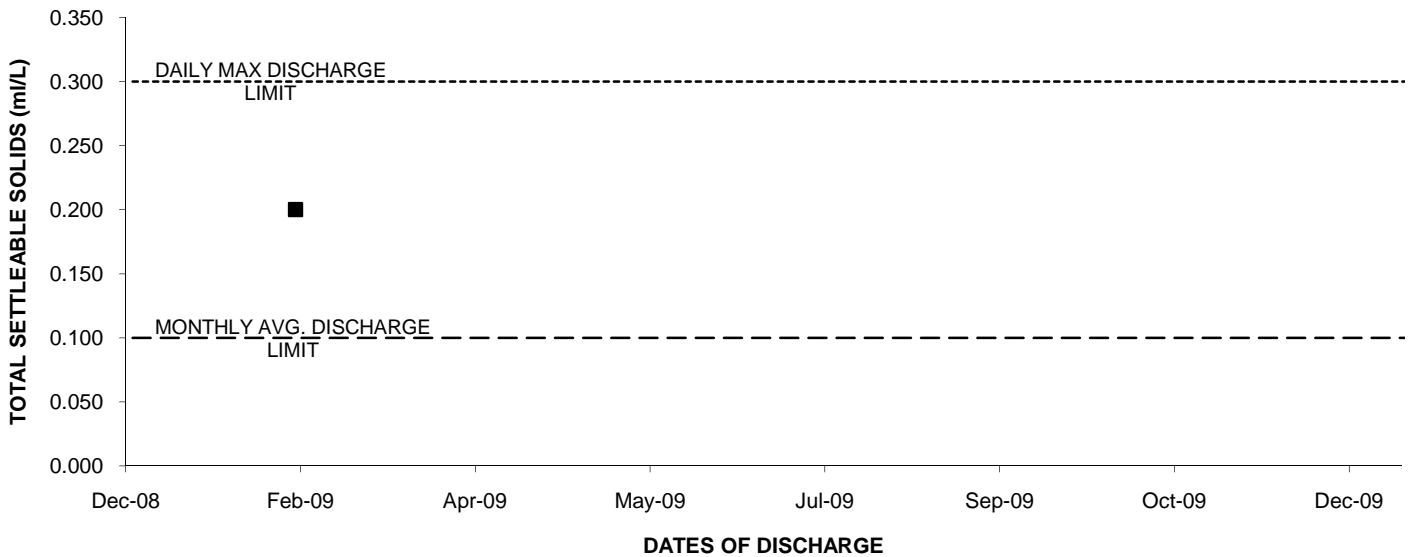


### 2009: OUTFALL 001 TOTAL SUSPENDED SOLIDS

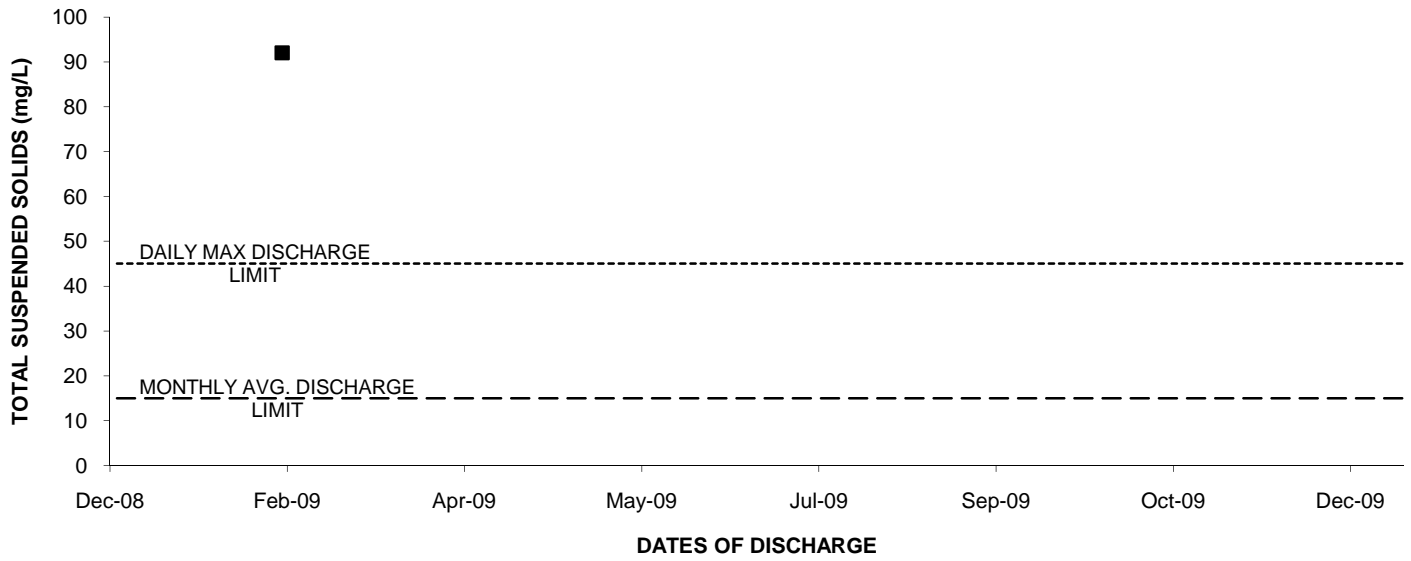


### 2009: OUTFALL 001 ALPHA-BHC

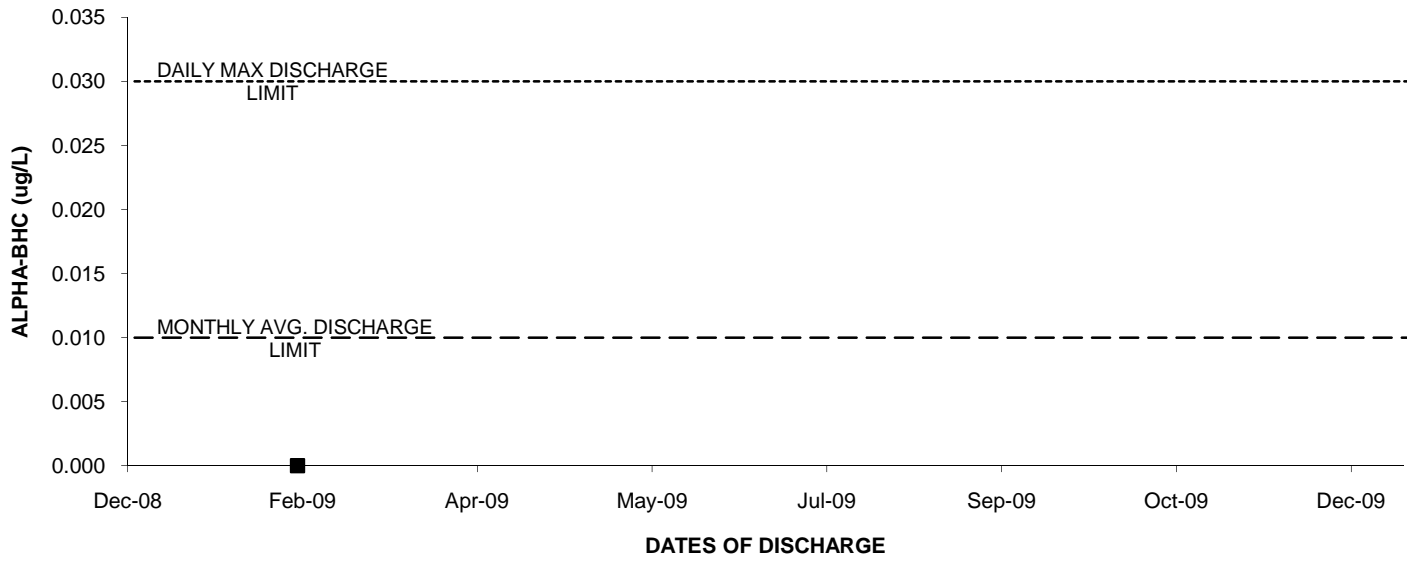


### 2009: OUTFALL 001 CESIUM 137

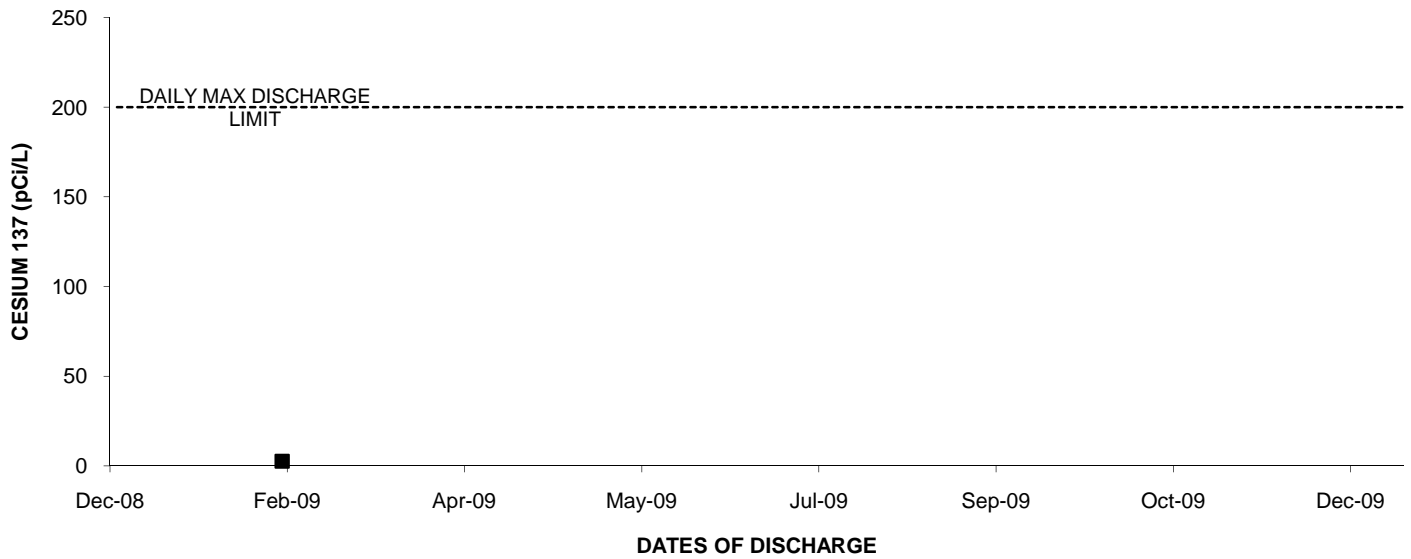


### 2009: OUTFALL 001 GROSS ALPHA

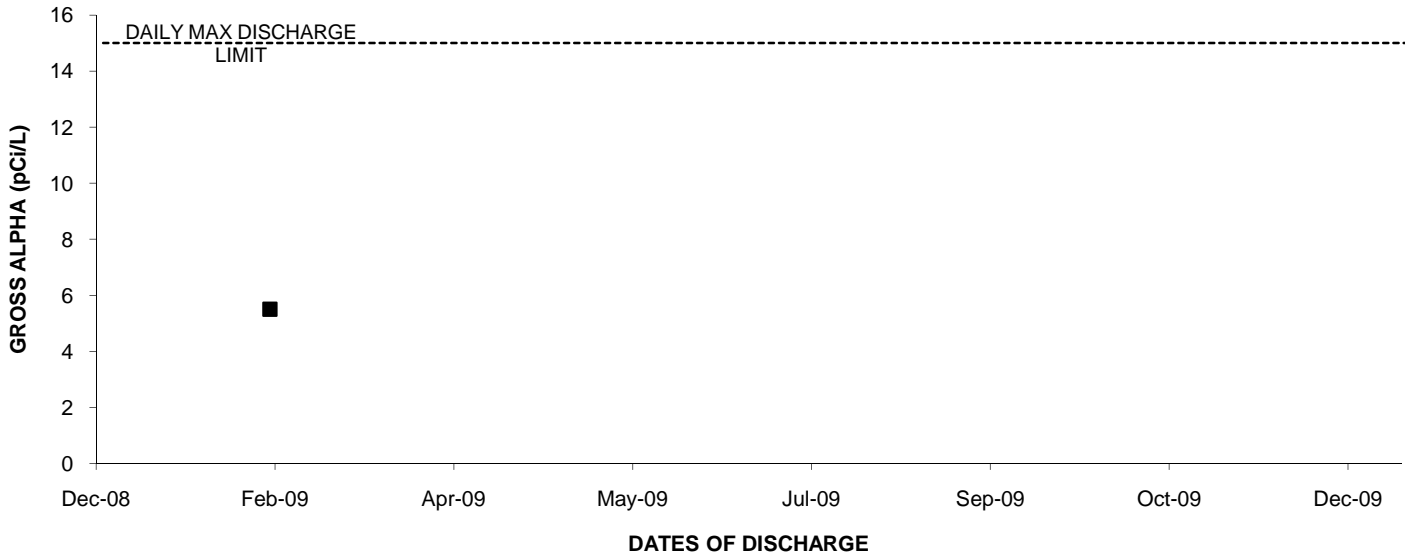

### 2009: OUTFALL 001 GROSS BETA

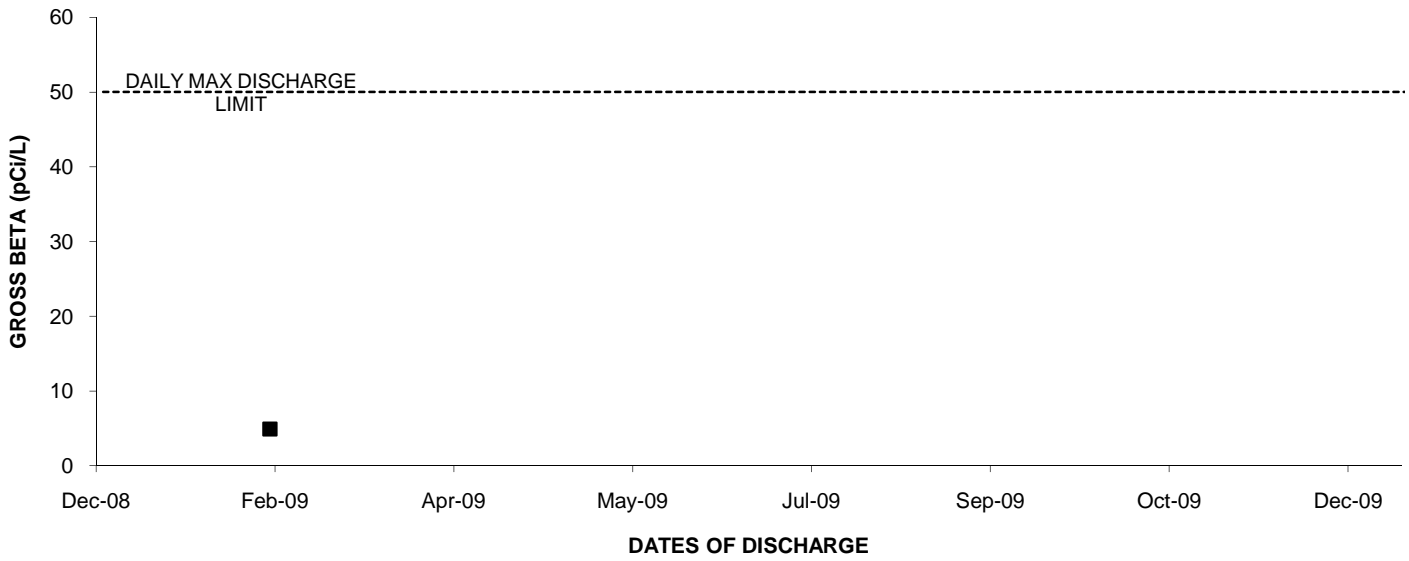


### 2009: OUTFALL 001 STRONTIUM-90

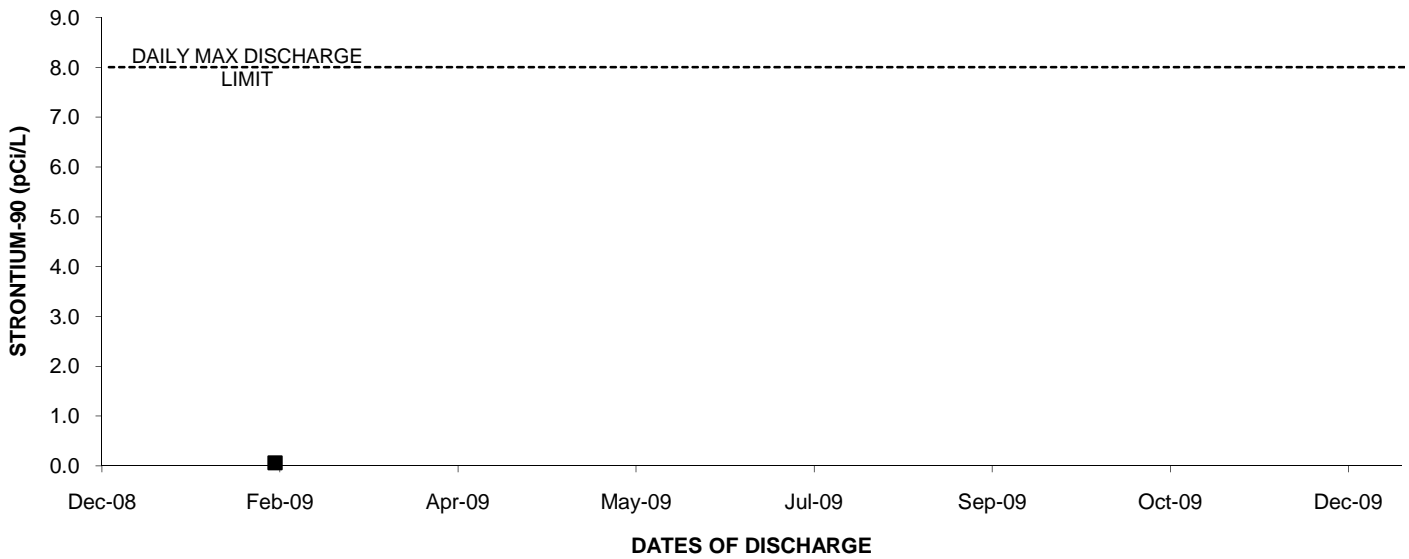





### 2009: OUTFALL 001 TOTAL COMBINED RADIUM-226 & RADIUM 228

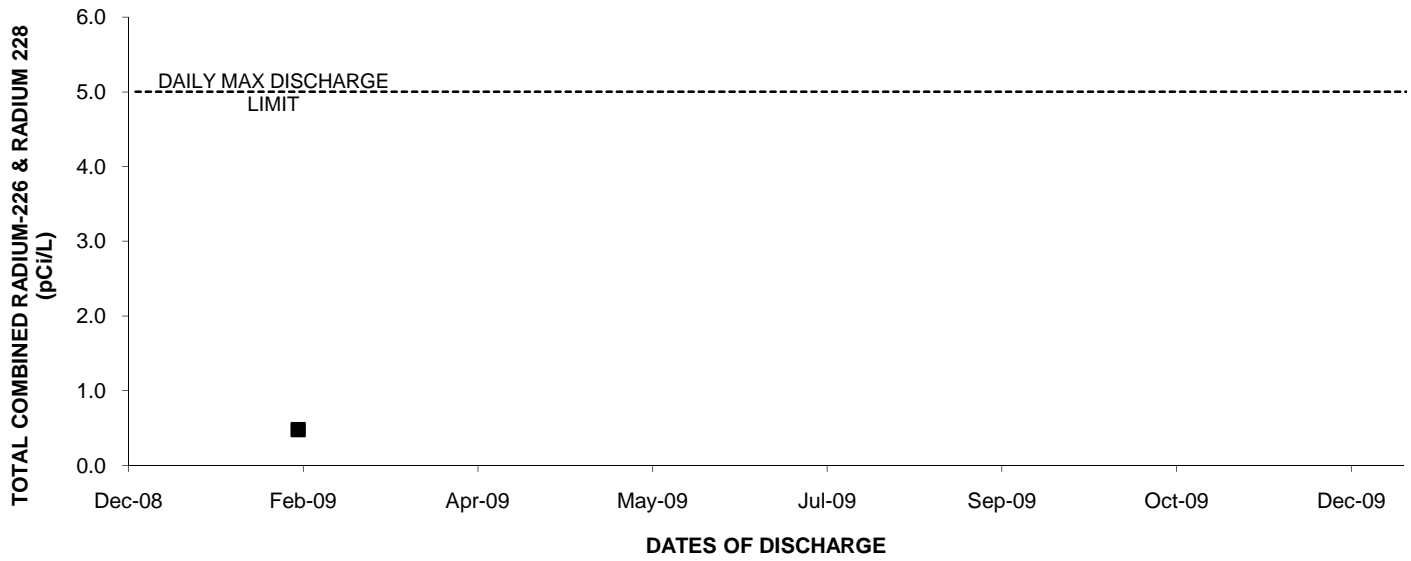


### 2009: OUTFALL 001 TRITIUM

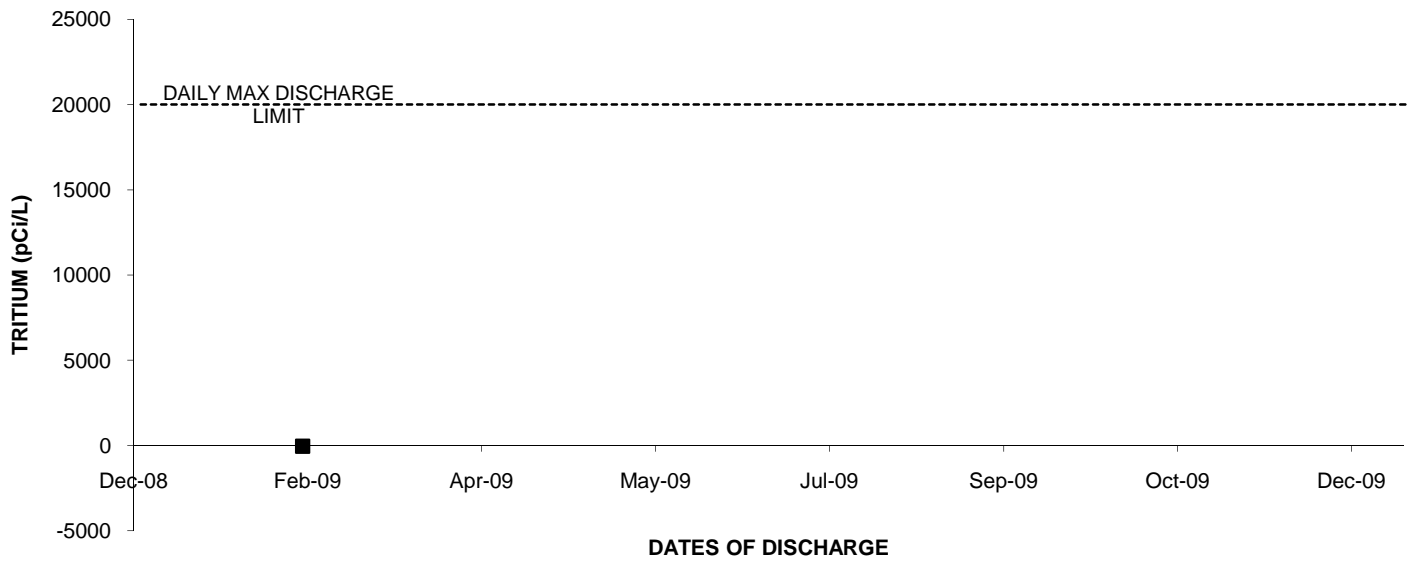

### 2009: OUTFALL 001 URANIUM, TOTAL

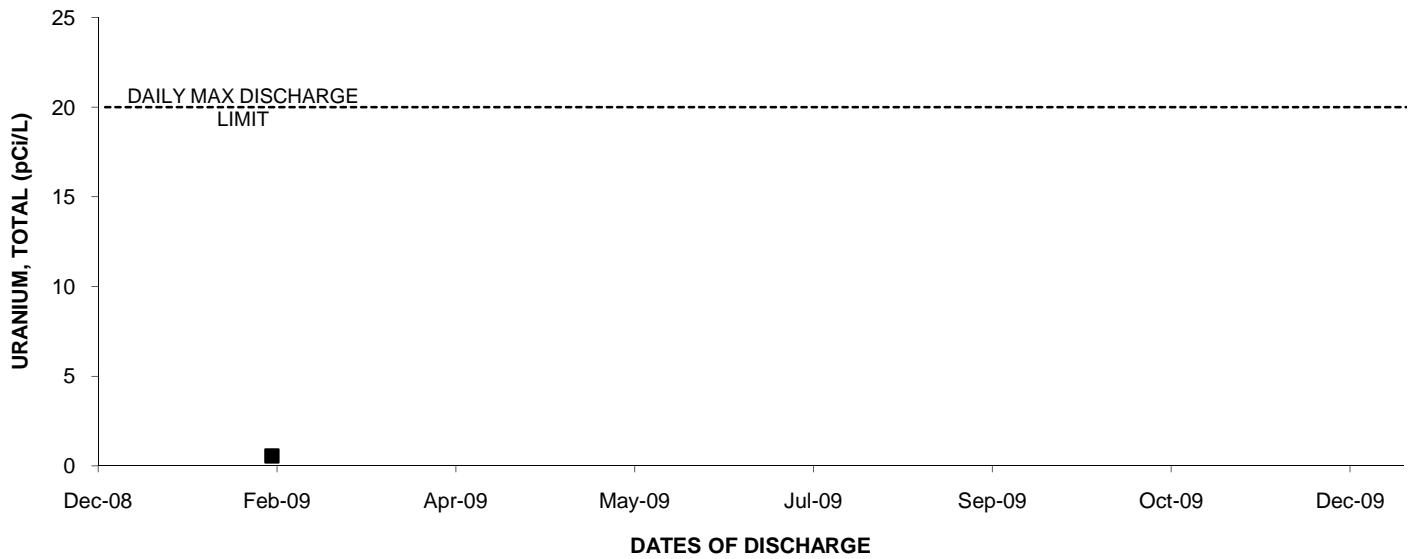

2009: OUTFALL 001 2,4,6-TRICHLOROPHENOL

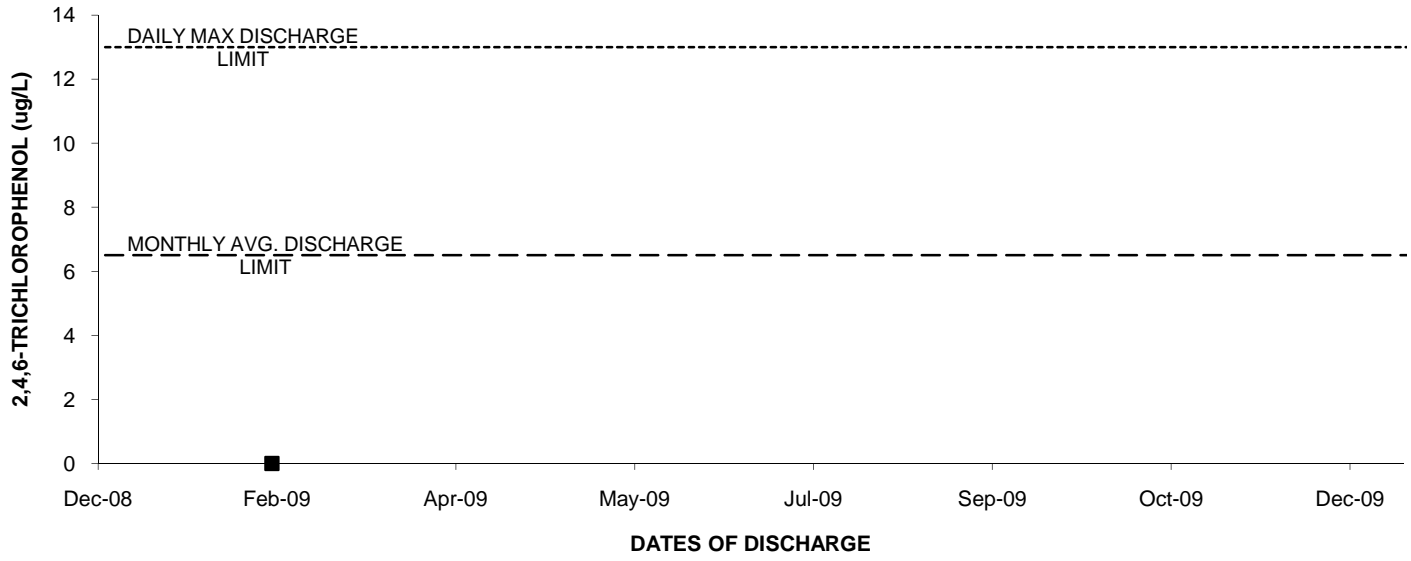

### 2009: Outfall 001 TCDD

